


50EZ

Comfort™ Single-Packaged Heat Pump Units with Puron®
(R-410A) Refrigerant
Single- And Three-Phase Units
2 to 5 Nominal Tons (Sizes 024-060)



Turn to the Experts.™

Product Data

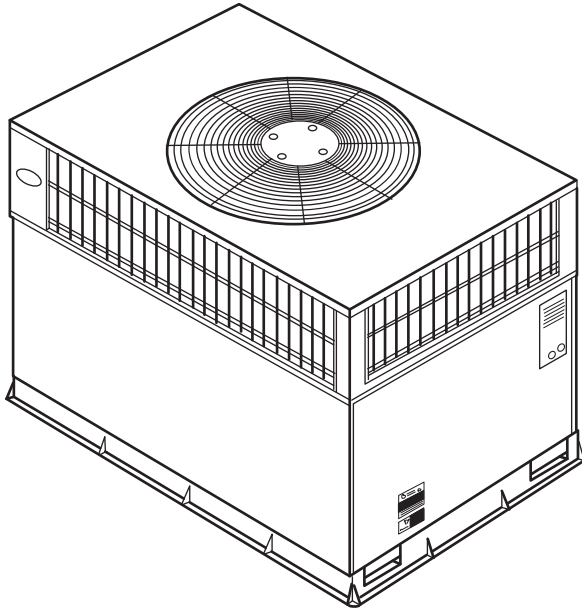

A99001

Fig. 1 - Unit 50EZ

Single-Packaged Products with Energy-Saving Features and Puron® refrigerant.

- Up to 13.5 SEER
- Up to 7.8 HSPF
- Up to 11.5 EER at 95°F OD
- Factory-Installed TXV
- Multi-Speed Blower-Standard

FEATURES/BENEFITS

One-piece Heat Pump unit with optional electric heater, low installation cost, dependable performance and easy maintenance.

Efficient operation High-efficiency design with SEERs (Seasonal Energy Efficiency Ratio) of up to 13.5.

Puron Environmentally Sound Refrigerant is Carrier's unique refrigerant designed to help protect the environment. Puron is an HFC refrigerant which does not contain chlorine that can harm the ozone layer. Puron refrigerant is in service in millions of systems, proving highly reliable, environmentally sound performance.

Easy Installation

Factory-assembled package is a compact, fully self-contained, heat pump unit that is prewired, pre-piped, and pre-charged for minimum installation expense. These units are available in a variety of standard capacity ranges with voltage options to meet residential and light commercial requirements. Units are lightweight and install easily on a rooftop or at ground level. The high tech composite base eliminates rust problems associated with ground level applications.

Durable, dependable components Compressors are designed for high efficiency. Each compressor is hermetically sealed against contamination to help promote longer life and dependable operation. Each compressor also has vibration isolation to provide quieter operation. All compressors have internal high pressure and overcurrent protection.

Direct-drive multi-speed brushless DC blower motor is standard on all 50EZ models. Direct-drive, PSC condenser-fan motors are designed to help reduce energy consumption and provide for cooling operation down to 40°F (4.4°C) outdoor temperature. Motormaster® II low ambient kit is available as a field installed accessory.

Thermostat controls designed to work as a system with Carrier's small packaged product.

Thermostatic Expansion Valve - A hard shutoff, balance port TXV maintains a constant superheat at the evaporator exit (cooling cycle) resulting in higher overall system efficiency.

Refrigerant system is designed to provide dependability. Liquid filter driers are used to promote clean, unrestricted operation. Each unit leaves the factory with a full refrigerant charge. Refrigerant service connections make checking operating pressures easier.

High and Low Pressure Switches provide added reliability for the compressor.

Indoor and Outdoor coils are computer-designed for optimum heat transfer and efficiency. The indoor coil is fabricated from copper tube and aluminum fins and is located inside the unit for protection against damage. The outdoor coil is internally mounted on the top tier of the unit. Copper fin coils and pre-coated fin coils are available from the factory by special order. These coils are recommended in applications where aluminum fins are likely to be damaged due to corrosion. They are ideal for seacoast applications.

Low sound ratings ensure a quiet indoor and outdoor environment with sound ratings as low as 74dBA.

Easy to service cabinets provide easy single-panel accessibility to serviceable components during maintenance and installation. The base with integrated drain pan provides easy ground level installation with or without a mounting pad. Convenient hand-holds are provided to manipulate the unit on the jobsite. A nesting feature ensures a positive basepan to roof curb seal when the unit is roof mounted. A convenient 3/4-in. wide perimeter flange makes frame mounting on a rooftop easy.

Convertible duct configuration

Unit is designed for easy use in either downflow or horizontal applications. Each unit is easily converted from horizontal to downflow with the two duct covers, standard on 3 phase units and available as an accessory for single phase units. Downflow operation is easily provided in the field to allow vertical ductwork connections. The basepan utilizes knockout style seals on the bottom openings to ensure a positive seal in the horizontal airflow mode.

Cabinets are constructed of heavyduty, phosphated, zinc-coated prepainted steel capable of withstanding 500 hours in salt spray. Interior surfaces of the evaporator and electric heater compartments are insulated with cleanable semi-rigid insulation


board, which keeps the conditioned air from being affected by the outdoor ambient temperature and provides improved indoor air quality. (Conforms to American Society of Heating, Refrigeration and Air Conditioning Engineers No. 62P.) The sloped drain pan minimizes standing water in the drain. An external drain is provided.

Short-Cycling protection for the compressor is incorporated into our defrost control board ensuring a five minute delay (+/-2 minutes) before restarting compressor after shutdown for any reason.

TABLE OF CONTENTS

FEATURES/BENEFITS	1-2
MODEL NUMBER NOMENCLATURE	2
ARI CAPACITIES	3
PHYSICAL DATA	4
OPTIONS AND ACCESSORIES	5
BASE UNIT DIMENSIONS	8-9
ACCESSORY DIMENSIONS	10
SELECTION PROCEDURE	11
PERFORMANCE DATA	12-18
TYPICAL PIPING AND WIRING	20
APPLICATION DATA	21
ELECTRICAL DATA	22-23
TYPICAL WIRING SCHEMATICS	24-2
CONTROLS	27
GUIDE SPECIFICATIONS	28-29

MODEL NUMBER NOMENCLATURE

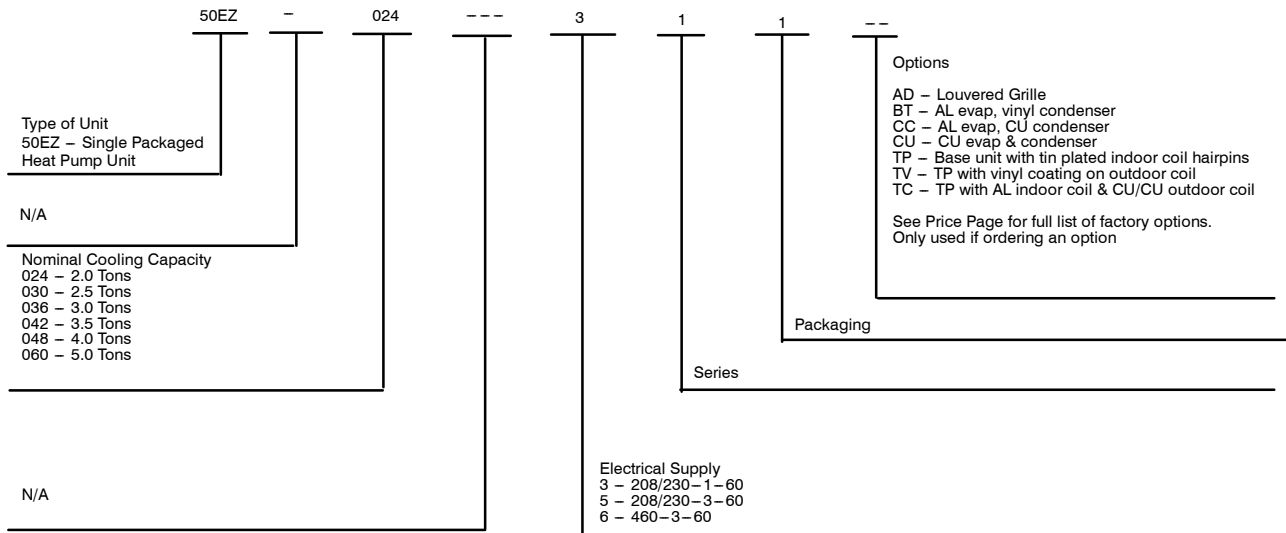

LEGEND
 AL – Aluminum
 CU – Copper
 N/A – Not applicable



ARI* CAPACITIES
COOLING CAPACITIES AND EFFICIENCIES

50EZ	NOMINAL TONS	STANDARD CFM	COOLING CAPACITY	EER	SEER
024---311	2	800	24000	11.5	13.5
030---311/511	2.5	1000	30000	11.2	13.2
036---311/511/601	3	1200	35400	11.5	13.5
042---311/511/601	3.5	1400	40500	11.2	13.4
048---311/511/601	4	1600	47500	11.5	13.5
060---311/511/601	5	1750	57000	11.4	13.0

HEAT PUMP HEATING CAPACITIES AND EFFICIENCIES

50EZ	HEATING CAPACITY (BTUH) @ 47 °F (8.3 °C)	COP @ 47 °F (8.3 °C)	HEATING CAPACITY (BTUH) @ 17 °F (-8.3 °C)	COP @ 17 °F (-8.3 °C)	HSPF
024---311	24000	3.5	12400	2.2	7.8
030---311/511	30000	3.5	17600	2.3	7.8
036---311/511/601	35400	3.5	19000	2.2	7.8
042---311/511/601	40500	3.5	21800	2.2	7.7
048---311/511/601	47000	3.6	25600	2.3	7.7
060---311/511/601	56000	3.5	30800	2.2	7.8

LEGEND

dB—Sound Levels (decibels)

db—Dry Bulb

SEER—Seasonal Energy Efficiency Ratio

wb—Wet Bulb

COP—Coefficient of Performance

HSPF—Heating Season Performance Factor

* Air Conditioning & Refrigeration Institute.

**At "A" conditions—80°F (26.7°C) indoor db/67°F (19.4°C) indoor wb & 95°F (35°C) outdoor db.

† Rated in accordance with U.S. Government DOE Department of Energy test procedures and/or ARI Standards 210/240.

Notes:

1. Ratings are net values, reflecting the effects of circulating fan heat. Ratings are based on:

Cooling Standard: 80°F (26.7°C) db, 67°F (19.4°C) wb indoor entering—air temperature and 95°F (35°C) db outdoor entering—air temperature.

2. Before purchasing this appliance, read important energy cost and efficiency information available from your retailer.

50EZ

PHYSICAL DATA - UNIT 50EZ

UNIT SIZE	50EZ024	50EZ030	50EZ036	50EZ042	50EZ048	50EZ060
NOMINAL CAPACITY (ton)	2	2.5	3	3.5	4	5
OPERATING WEIGHT† (lb)	302	307	324	382	415	434
(kg)	137	139	147	173	188	197
COMPRESSOR QUANTITY	1					
TYPE	SCROLL COMPRESSOR					
REFRIGERANT	R-410A					
Refrigerant (R-410A) Quantity (lb)	8.8	7.4	9.6	10.2	9.9	12.5
Quantity (kg)	4.0	3.4	4.4	4.6	4.5	5.7
METERING DEVICE ID	TXV					
ORIFICE OD (in.)	0.032 (2)		0.035 (Left OD Coil)		0.052 (2)	
(mm)	.81		0.038 (Right OD Coil)		1.3	
OUTDOOR COIL	0.038 (2)		.89/97		0.040 (2)	
Rows... Fins/in.	2...21		2...21		2...21	
face area (sq. ft.)	11.9		13.6		15.5	
OUTDOOR FAN	2350		2800		3300	
Nominal Airflow (CFM)	22		22		22	
Diameter Motor HP (RPM)	1/8 (825)		1/8 (825)		1/4 (1100)	
INDOOR COIL	3...17		4...15		3...17	
Rows... Fins/in.	3.7		3.7		4.7	
face area (sq. ft.)	800		1200		1600	
INDOOR BLOWER	1000		1400		1750	
Nominal Cooling Airflow (CFM)	10x10		11x10		11x10	
Size (in.)	254x254		279x254		279x254	
(mm)	1/2		3/4		1.0	
Motor (HP)	650±15		420±25		20±5	
HIGH-PRESSURE SWITCH (psig)	Cutout		Reset (Auto)		45±10	
LOSS-OF-CHARGE/LOW-PRESSURE SWITCH	20±5		45±10		20±5	
(Liquid Line) (psig)	Cutout		Reset (Auto)		45±10	
RETURN-AIR FILTERS*†	20x20x1		24x30x1		24x36x1	
throwaway (in.)	508x508x25		610x762x25		610x914x25	
(mm)	508x610x25					

*Required filter sizes shown are based on the larger of the ARI (Air conditioning and Refrigeration Institute) rated cooling airflow or the heating airflow velocity of 300 ft/minute for throwaway type or 450 ft/minute for high-capacity type. Air filter pressure drop for non-standard filters must not exceed 0.08 IN. W.C.

† If using accessory filter rack refer to the filter rack installation instructions for correct filter size and quantity.

‡ For 460 volt units, add 14 lb (6.4 kg) to the weight.

OUTDOOR SOUND: OCTAVE BAND DATA

MODEL 50EZ	SOUND RATING (dBA)	TYPICAL OCTAVE BAND SPECTRUM (dBA) (without tone adjustment)						
		125	250	500	1000	2000	4000	8000
024---311	76	62.5	67.0	71.5	69.0	66.0	60.5	55.0
030---311/511	76	68.5	65.0	70.5	70.0	67.0	63.0	56.5
036---311/511/601	75	65.5	63.5	67.5	69.5	65.5	61.0	53.5
042---311/511/601	74	63.5	63.0	67.0	69.5	68.5	62.5	59.5
048---311/511/601	78	63.0	70.0	71.0	73.0	70.0	65.5	59.5
060---311/511/601	78	65.0	67.0	71.5	72.5	71.5	68.0	60.5

*Tested in accordance with ARI Standard 270-95 (not listed in ARI).

50EZ

OPTIONS AND ACCESSORIES

Factory-installed options

Louver grille provides hail and vandalism protection. A wire grille is standard on all models. See model number nomenclature for louver grille options.

Coil options include copper/copper and vinyl-coated construction for refrigerant coils. Units are shipped standard with copper tube/aluminum fin construction. See model number nomenclature for coil options.

Field-installed accessories

Economizer with Solid-State Controls and Barometric Relief Dampers
Manual Air Damper (25% open)
Electric Heaters
Filter Rack
Flat Roof Curbs (8-in. [203 mm] and 14-in. [356 mm])
Square-to-Round Duct Transition Kit
Thermostats
Crankcase Heater
Compressor Start Kit (for use on single-phase units only)
Rigging Kit
Low Ambient Kit (Motormaster® II Control)

Economizer with solid-state controls and barometric relief dampers includes filter racks and provide outdoor air during cooling and reduce compressor operation.

Manual outside air damper includes hood and filter rack with adjustable damper blade for up to 25% outdoor air.

Electric heaters provide additional heat in the unit when required. Each package has a heater module that slides into the controls compartment. Heater sizes range from 5.0 to 20.0 kW. The electric heater design allows the use of a single-point power supply for the entire unit, resulting in lower installed costs.

Filter rack features easy installation, serviceability, and high-filtering performance for vertical applications.

Flat roof curbs in both 8 in. (203 mm) and 14 in. (356 mm) sizes are available for roof mounted applications.

Square-to-round duct transition kit enables 024-048 size units to be fitted to 14 in. (356 mm) round ductwork.

Corporate Thermostats provide control for the system heating and cooling functions. Thermostat models are available in both programmable and non-programmable versions.

Crankcase heater provides anti-floodback protection for low-load cooling applications.

Compressor start kit assists compressor start-up by providing additional starting torque on single phase units and prolongs compressor motor life.

Rigging kit includes lifting brackets which are inserted into the unit base rigging holds to lift unit for rooftop applications.

Low-ambient kit (Motormaster II control) allows the use of mechanical cooling down to outdoor temperatures as low as 0°F (-18°C) when properly installed.

ELECTRIC HEATERS

ORDERING NO.	NOMINAL CAPACITY (kW @ 240 or 480 VOLTS)	USED WITH SIZES					
		024	030	036	042	048	060
208/230 – SINGLE PHASE – 60 HZ							
CPHEATER052A00	5.0	X	X	X			
CPHEATER064A00	5.0				X	X	X
CPHEATER069A00	7.2	X					
CPHEATER070A00	7.2		X	X	X	X	X
CPHEATER050A00	10.0	X	X	X	X	X	X
CPHEATER066A00	15.0		X	X	X	X	X
CPHEATER054A00	20.0				X	X	X
208/230 – THREE PHASE – 60 HZ							
CPHEATER055A00	5.0		X	X	X	X	X
CPHEATER056A00	10.0		X	X	X	X	
CPHEATER068A00	10.0						X
CPHEATER058A00	15.0		X	X	X	X	X
CPHEATER059A01	20.0				X	X	X
460 – THREE PHASE – 60 HZ							
CPHEATER060A00	5.0			X	X	X	X
CPHEATER061A00	10.0			X	X	X	X
CPHEATER062A00	15.0			X	X	X	X
CPHEATER063A00	20.0				X	X	X



NOTE: Electric heaters are rated at 240v. Refer to Multiplication Factors table for other voltages.
X = Approved combination

Minimum Airflow for Reliable Electric Heater Operation (cfm)

UNIT-50EZ	024	030	036	042	048	060
AIRFLOW	800	1025	1250	1400	1710	1800


50EZ

ECONOMIZER

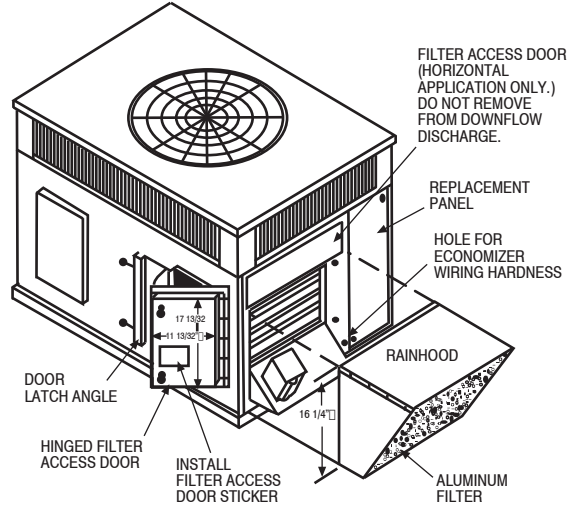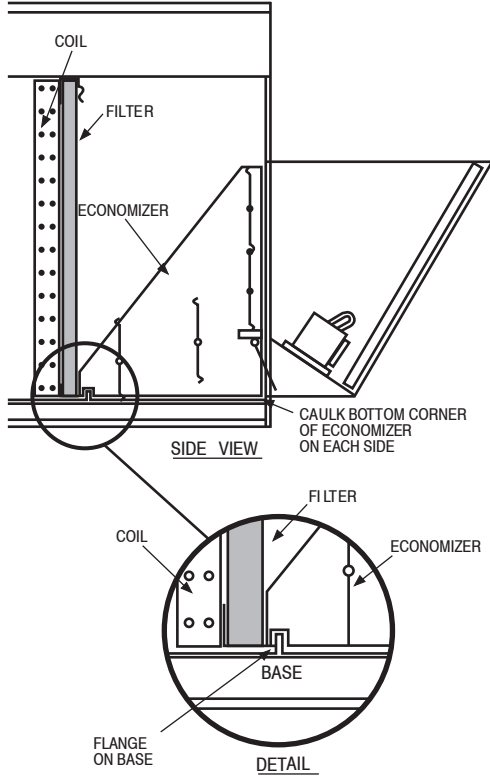


50EZ

FILTER RACK

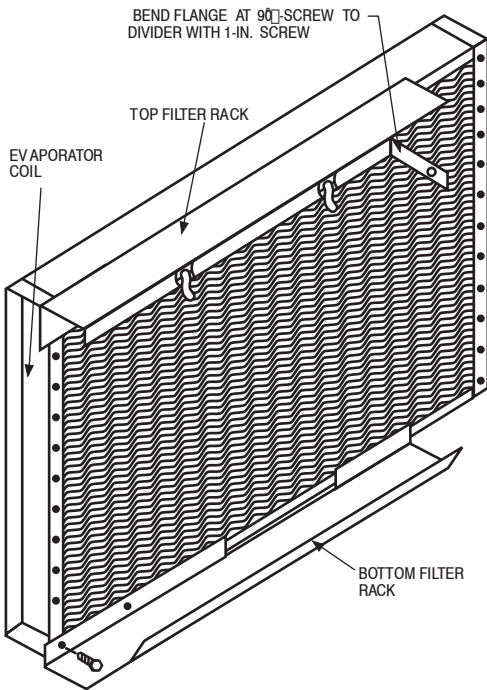

MANUAL OUTSIDE AIR DAMPER

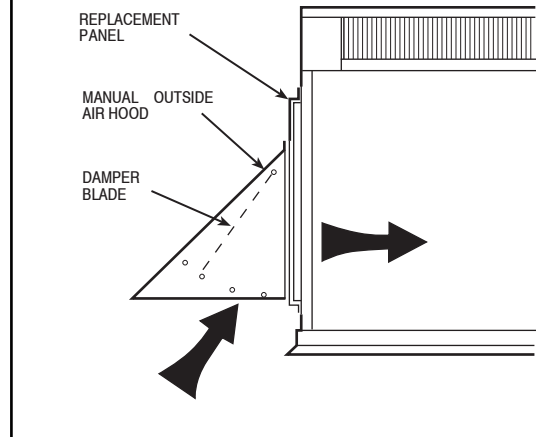

UNIT DIMENSIONS - 50EZ024-036

50EZ

UNIT	SERIES	ELECTRICAL CHARACTERISTICS	UNIT WT.		UNIT HEIGHT	CENTER OF GRAVITY IN/MM					
			LBS	KG		"A"	X	Y	Z		
50EZ024	1	208/230-1-60	302	137	39.02(1991.11)	20	[508]	19	[489]	18	[447]
50EZ030	1	208/230-1-60, 208/230-3-60	307	139	39.02(1991.11)	20	[508]	19	[489]	18	[447]
50EZ036	1	208/230-1-60, 208/230-3-60, 460-3-60	324	147	41.02(1041.91)	20	[508]	14	[356]	13	[330]
50EZ036	0	460-3-60	338	153	41.02(1041.91)	21	[533]	14	[356]	13	[330]

REQUIRED CLEARANCES TO COMBUSTIBLE MATL.

	INCHES (MM)
TOP OF UNIT	14.00 (355.6)
TOP OF UNIT	14.00 (355.6)
SIDE OF UNIT	14.00 (355.6)
SIDE OF DUCTS	14.00 (355.6)
BOTTOM OF UNIT	0.0
FLUE PANEL	36.00 (914.4)

NEC REQUIRED CLEARANCES

	INCHES (MM)
BETWEEN UNITS	42.00 (1066.8)
BETWEEN UNITS, POWER ENTRY SIDE	42.00 (1066.8)
BETWEEN UNITS, POWER ENTRY SIDE	36.00 (914.4)
UNIT AND BLOCK OR CONCRETE WALLS AND OTHER GROUNDED SURFACES, POWER ENTRY SIDE	42.00 (1066.8)


REQUIRED CLEARANCE FOR OPERATION AND SERVICING

	INCHES (MM)
EVAP. COIL ACCESS SIDE	36.00 (914.4)
EVAP. COIL ACCESS SIDE	42.00 (1066.8)
EVAP. COIL ACCESS SIDE (EXCEPT FOR REC REQUIREMENTS)	42.00 (1066.8)
UNIT TOP OPPOSITE DUCTS	48.00 (1219.2)
UNIT TOP OPPOSITE DUCTS	36.00 (914.0)
DUCT PANEL	12.00 (304.8)


*MINIMUM DISTANCES: IF UNIT IS PLACED LESS THAN 12.00 (304.8) FROM WALL SYSTEM, THEN SYSTEM PERFORMANCE MAYBE COMPROMISED.

DIMENSIONS IN () ARE IN MILLIMETERS

	OPERATIONAL CORNER WEIGHTS, LBS/KG		
	"1"	"2"	"4"
024	60/27	48/22	72/33
030	61/28	49/22	74/33
036	65/29	52/24	78/35

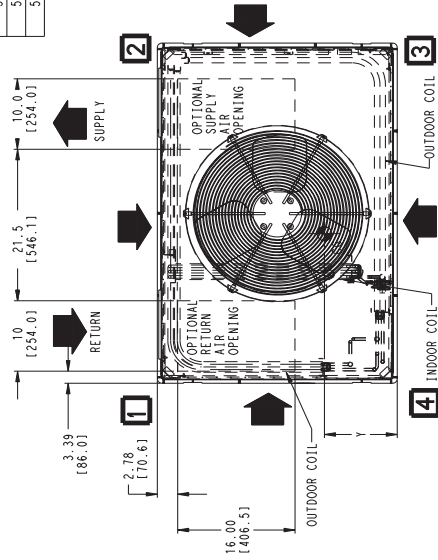

TOP VIEW

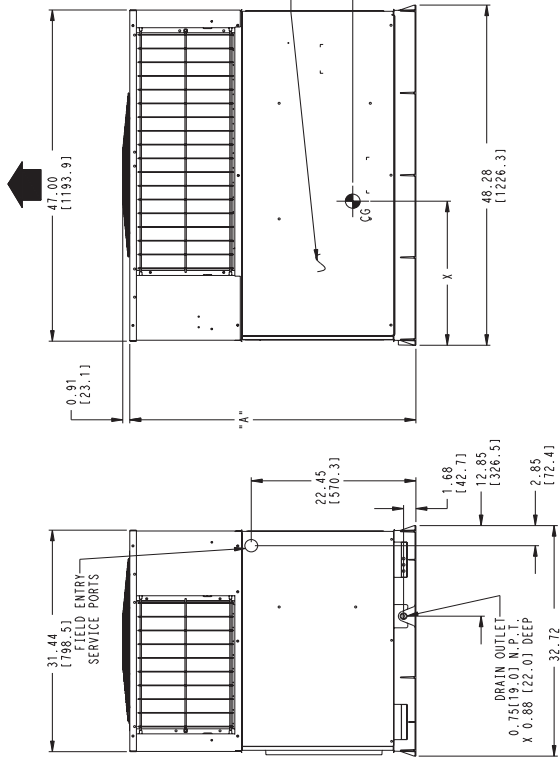

FRONT VIEW

LEFT SIDE VIEW

RIGHT SIDE VIEW

REAR VIEW

50EZ500019 REV 3.0



UNIT DIMENSIONS - 50EZ042-060

UNIT	SERIES	ELECTRICAL CHARACTERISTICS	UNIT WT.		UNIT HEIGHT "A"	CENTER OF GRAVITY IN/AMM					
			LBS	KG		X	Y	Z			
50E7042	1	208/230-1-60, 208/230-3-60	382	174	42.98(1091.7)	21	1533	21	1521	17	1422
50E7048	1	208/230-1-60, 208/230-3-60	415	188	42.98(1091.7)	21	1533	21	1521	17	1422
50E2060	1	208/230-1-60, 208/230-3-60	434	197	46.98(1193.3)	21	1533	20	1508	18	1447
50E7042	0	460-3-60	396	180	42.98(1091.7)	21	1533	20	1508	17	1422
50E7048	0	460-3-60	429	195	42.98(1091.7)	21	1533	20	1508	17	1422
50E2060	0	460-3-60	448	203	46.98(1193.3)	21	1533	20	1508	18	1447

REQUIRED CLEARANCES TO COMBUSTIBLE MATL.

TOP OF UNIT	INCHES	MM
DUCT SIDE OF UNIT	14.00	(355.6)
SIDE OPPOSITE DUCTS	2.00	(50.8)
BOTTOM OF UNIT	14.00	(355.6)
ELECTRIC HEAT PANEL	0.00	(12.7)
	36.00	(914.4)
NEC. REQUIRED CLEARANCES.		
INCHES	MM	
BETWEEN UNITS, POWER ENTRY SIDE	42.00	(1066.8)
UNIT AND UNGROUND SURFACES, POWER ENTRY SIDE	42.00	(1066.8)
UNIT AND BLOCK OR CONCRETE WALLS AND OTHER GROUND SURFACES, POWER ENTRY SIDE	36.00	(914.4)
REQUIRED CLEARANCE FOR OPERATION AND SERVICING		
INCHES	MM	
EVAP. COIL ACCESS SIDE	36.00	(914.4)
POWER ENTRY SIDE (EXCEPT FOR NEC REQUIREMENTS)	42.00	(1066.8)
UNIT TOP	48.00	(1219.2)
SIDE OPPOSITE DUCTS	36.00	(914.4)
DUCT PANEL	12.00	(304.8)

*OPERATING CORNER WEIGHTS LBS/KG			
"1"	"2"	"3"	"4"
042	76/35	61/28	92/42
048	83/38	66/30	100/45
060	87/39	69/32	104/47

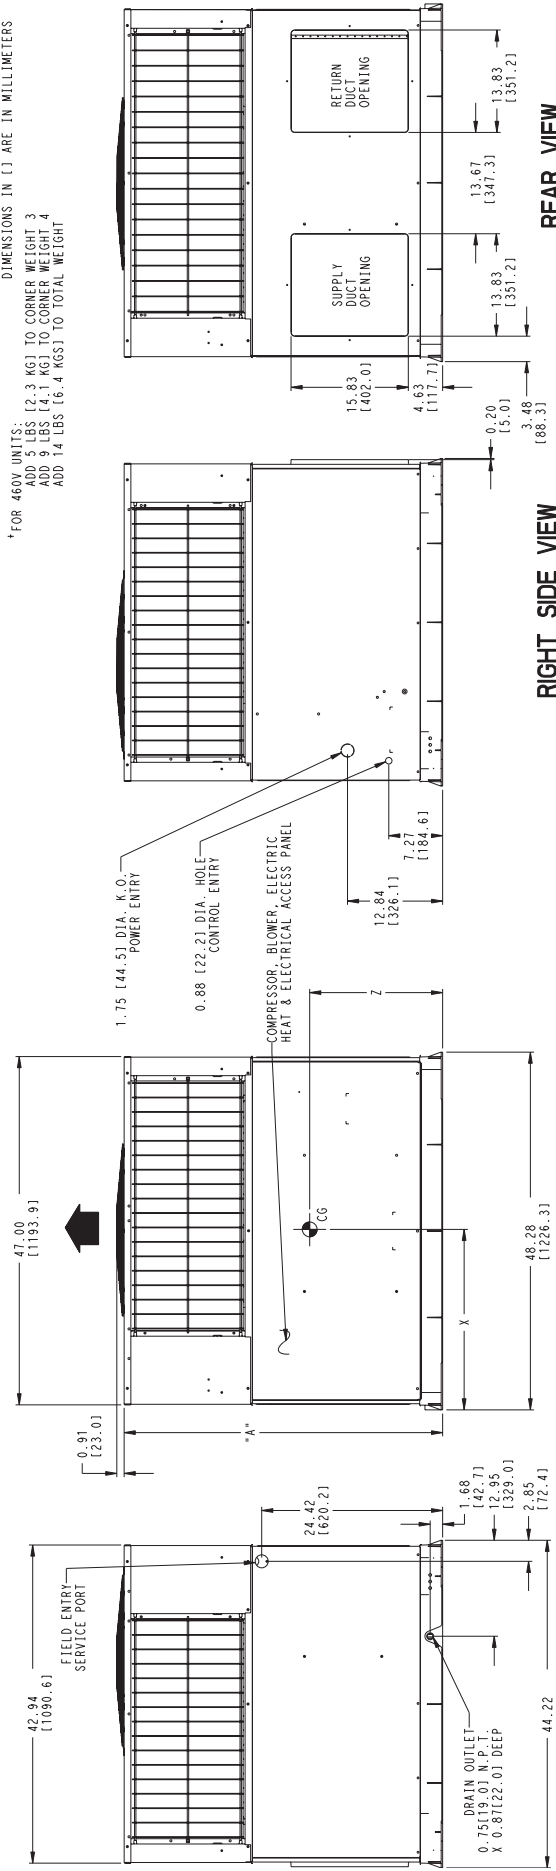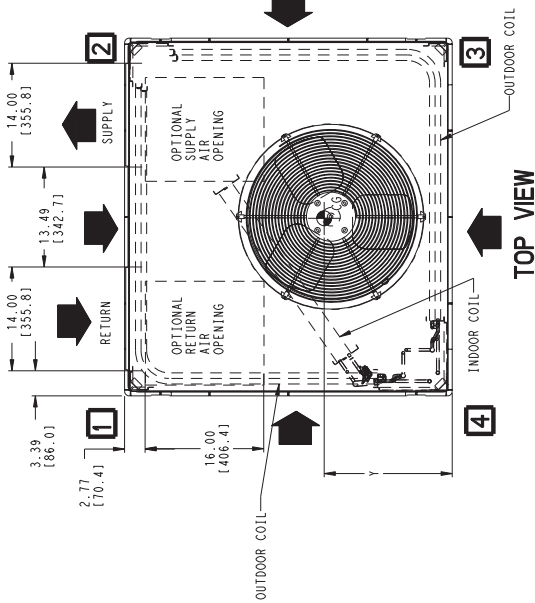

DIMENSIONS IN () ARE IN MILLIMETERS

*FOR 460V UNITS:
 ADD 5 LBS (2.3 KG) TO CORNER WEIGHT 3
 ADD 9 LBS (4.1 KG) TO CORNER WEIGHT 4
 ADD 14 LBS (6.4 KGS) TO TOTAL WEIGHT


*MINIMUM DISTANCES-IF UNIT IS PLACED LESS THAN 12.00 (304.8) FROM WALL SYSTEM, THEN SYSTEM PERFORMANCE MAYBE COMPROMISED.

50EZ
 50EZ500020
 REV 2.0

50EZ


ACCESSORY DIMENSIONS

50EZ

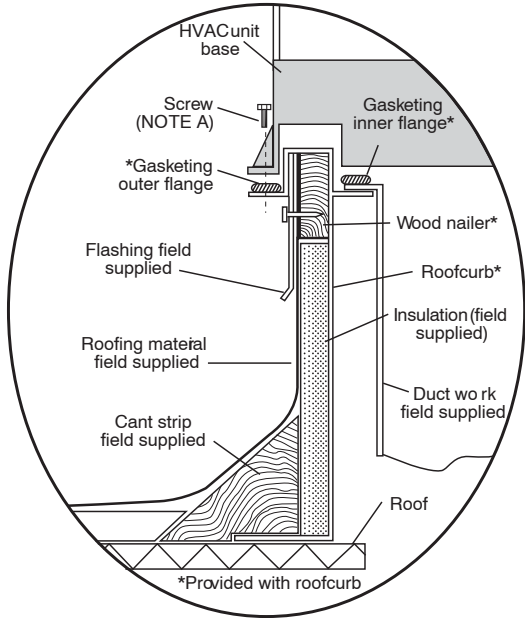



Roof Curb for Small Cabinet

Note A: When unit mounting screw is used, retainer bracket must also be used.

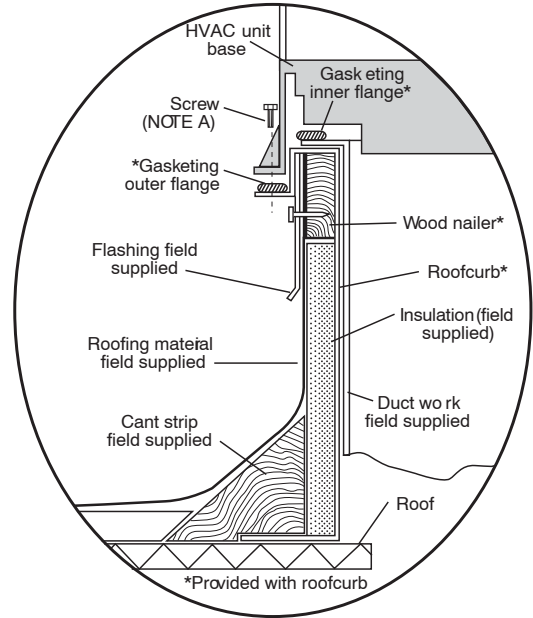

Roof Curb for Large Cabinet

Note A: When unit mounting screw is used, retainer bracket must also be used.

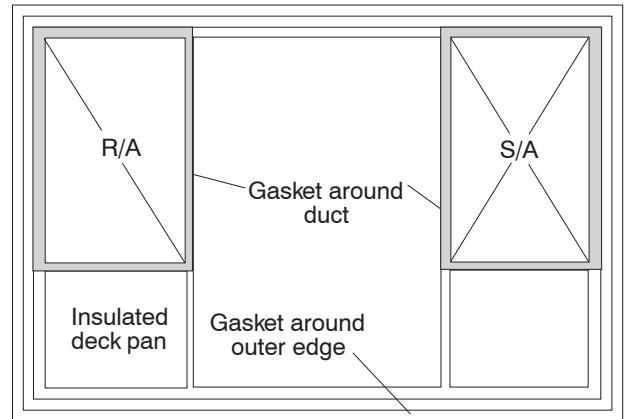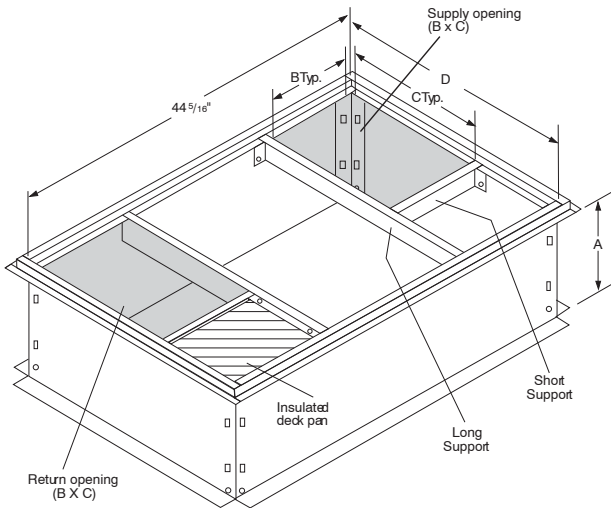


C00076


UNIT SIZE	CATALOG NUMBER	A IN. (MM)	B IN. (MM)	C IN. (MM)	D IN. (MM)
50EZ024-036	CPRFCURB006A00	8 (203)	11 (279)	16-1/2 (419)	28-3/4 (730)
	CPRFCURB007A00	14 (356)	11 (279)	16-1/2 (419)	28-3/4 (730)
50EZ042-060	CPRFCURB008A00	8 (203)	16-3/16 (411)	17-3/8 (441)	40-1/4 (1022)
	CPRFCURB009A00	14 (356)	16-3/16 (411)	17-3/8 (441)	40-1/4 (1022)

NOTES:

1. Roof curb must be set up for unit being installed.
2. Seal strip must be applied, as required, to unit being installed.
4. Dimension in () are in millimeters.
5. Roof curb is made of 16-gauge steel.
6. Attach ductwork to curb (flanges of duct rest on curb).
7. Insulated panels: 1-in. (25 mm) thick fiberglass 1 lb. density.
8. When unit mounting screw is used (see Note A), a retainer bracket must be used as well. This bracket must also be used when required by code for hurricane or seismic conditions. This bracket is available through Micrometl.

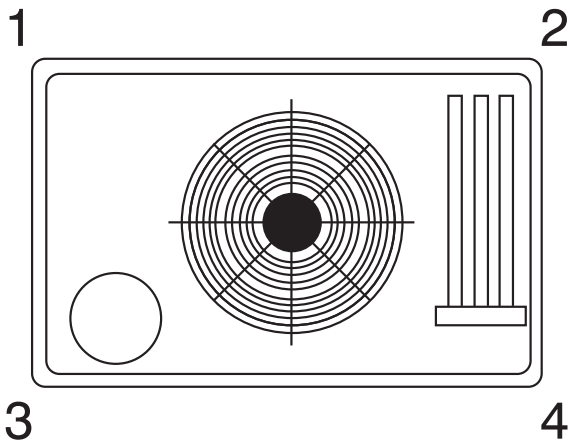

A07216

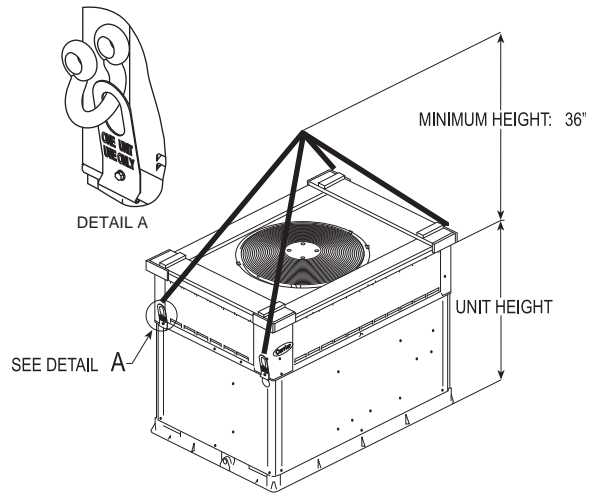

A05161

SELECTION PROCEDURE (WITH EXAMPLE)

1. Determine cooling and heating requirements at design conditions:

Given:

- Required Cooling Capacity (TC) 34,500 Btuh
- Sensible Heat Capacity (SHC) 26,000 Btuh
- Required Heating Capacity 60,000 Btuh
- Condenser Entering Air Temperature 95°F (35°C)
- Indoor-Air Temperature 80°F (27°C) edb 67°F (19°C) ewb
- Evaporator Air Quantity 1200 CFM
- External Static Pressure 0.200 IN.W.C.
- Electrical Characteristics 208-1-60

2. Select unit based on required cooling capacity.

Enter Net Cooling Capacities table at condenser entering temperature of 95°F (35°C). Unit 036 at 1200 cfm and 67°F (19°C) ewb (entering wet bulb) will provide a total capacity of 35,400 Btuh and a SHC of 26,200 Btuh. Calculate SHC correction, if required, using Note 4 under Cooling Capacities tables.

3. Select heating capacity of unit to provide design condition requirement.

In the Heating Capacities and Efficiencies table, note that the 036 size unit will deliver 35,400 BTUH at the ARI high temp rating point. To achieve 60,000 BTUH, accessory electric heat will be required. Use the Balance Point Worksheet to plot the load line with the unit capacity. The difference between the load line and unit capacity at the design heating temperature is the amount of electric heat that will be required.

4. Determine fan speed and power requirements at design conditions.

Before entering the air delivery tables, calculate the total static pressure required. From the given example, the Wet Coil Pressure Drop Table, and the Filter Pressure Drop Table:

External Static Pressure	0.200 IN. W.C.
Filter	0.130 IN. W.C.
Wet Coil Pressure Drop	<u>0.18</u> IN. W.C.
Total Static Pressure	0.51 IN. W.C.

Enter the table for Dry Coil Air Delivery— At 0.50 IN. W.C. ESP (external static pressure) and MEDIUM speed the motor delivers 1209 cfm.

5. Select unit that corresponds to power source available.

The Electrical Data Table shows that the unit is designed to operate at 208/230-1-60.

50EZ

PERFORMANCE DATA
024 Cooling Extended Performance Table

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F (°C)																	
		75 (23.9)			85 (29.4)			95 (35)			105 (40.6)			115 (46.1)			125 (51.7)		
		CFM / BF	EWB of (°C)	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	
Total	Sens			Total	Sens		Total	Sens		Total	Sens		Total	Sens					
700 / 0.07	57 (13.9)	25.26	25.26	1.76	23.08	23.08	20.94	20.94	2.05	18.84	18.84	2.19	16.77	16.77	2.34	14.69	14.69	2.47	
	62 (16.7)	26.21	22.41	1.76	23.78	21.19	21.41	20.00	2.05	19.09	18.76	2.20	16.84	17.43	2.34	14.70	14.70	2.47	
	63* (17.2)	26.60	18.28	1.76	24.11	17.22	21.68	16.19	2.05	19.30	15.13	2.20	16.96	14.06	2.34	14.65	12.96	2.47	
	67 (19.4)	28.72	19.01	1.77	26.05	17.92	23.44	16.87	2.06	20.89	15.80	2.21	18.38	14.71	2.35	15.87	13.58	2.49	
	72 (22.2)	31.48	15.60	1.79	28.57	14.64	25.72	13.69	2.08	22.93	12.73	2.22	20.16	11.75	2.37	17.41	10.71	2.50	
	57 (13.9)	26.43	26.43	1.79	24.14	24.14	21.88	21.88	2.07	19.65	19.65	2.22	17.46	17.46	2.36	15.26	15.26	2.50	
	62 (16.7)	26.97	24.05	1.79	24.47	22.72	22.03	21.40	2.07	19.68	19.68	2.22	17.46	17.46	2.36	15.27	15.27	2.50	
800 / 0.08	63* (17.2)	27.31	19.46	1.79	24.73	18.35	22.21	17.24	2.08	19.74	16.12	2.22	17.32	15.02	2.36	14.93	13.84	2.49	
	67 (19.4)	29.48	20.26	1.80	26.71	19.14	24.00	18.00	2.09	21.36	16.88	2.23	18.75	15.74	2.37	16.16	14.52	2.51	
	72 (22.2)	32.29	16.38	1.81	29.27	15.39	26.31	14.39	2.10	23.42	13.39	2.25	20.55	12.36	2.39	17.71	11.29	2.52	
	57 (13.9)	27.44	27.44	1.81	25.03	25.03	22.67	22.67	2.10	20.35	20.35	2.24	18.05	18.05	2.39	15.74	15.74	2.52	
	62 (16.7)	27.64	25.52	1.81	25.08	25.08	22.67	22.67	2.10	20.35	20.35	2.24	18.05	18.05	2.39	15.74	15.74	2.52	
	63* (17.2)	27.88	20.58	1.81	25.22	19.43	22.63	18.27	2.10	20.09	17.10	2.24	17.61	15.92	2.38	15.16	14.68	2.51	
	67 (19.4)	30.08	21.47	1.82	27.23	20.30	24.44	19.11	2.11	21.72	17.92	2.25	19.05	16.71	2.40	16.39	15.43	2.53	
72 (22.2)	32.93	17.13	1.84	29.82	16.10	26.78	15.06	2.12	23.80	14.02	2.27	20.86	12.95	2.41	17.94	11.83	2.54		

*At 75°F (23.9 °C) entering dry bulb—Tennessee Valley Authority [TVA] rating conditions; all others at 80°F (26.7 °C) entering dry bulb. See Legend and Notes.

024 Heating Extended Performance Table -10-60 (-23.3-15.6 °C)

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES °F (°C)																							
		-10 (-23.3)			0 (-17.8)			10 (-12.2)			20 (-6.7)			30 (-1.1)			40 (4.4)			50 (10)			60 (15.6)		
		EDB CFM	CFM	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	
Total	Integ			Total	Integ		Total	Integ		Total	Integ		Total	Integ		Total	Integ		Total	Integ		Total	Integ		
65 (18.3)	700	7.11	6.54	1.48	9.66	8.89	1.56	12.29	11.28	1.63	15.05	13.65	1.70	17.95	15.76	1.78	21.45	21.45	1.88	25.15	25.15	2.00	29.74	29.74	2.15
	800	7.26	6.68	1.49	9.82	9.04	1.56	12.47	11.44	1.62	15.24	13.82	1.68	18.23	15.98	1.75	21.75	21.75	1.84	25.58	25.58	1.94	30.48	30.48	2.07
	900	7.39	6.80	1.50	9.96	9.17	1.56	12.62	11.58	1.61	15.40	13.97	1.67	18.44	16.16	1.73	21.91	21.91	1.81	25.96	25.96	1.90	30.75	30.75	2.02
70 (21.1)	700	6.67	6.13	1.54	9.28	8.54	1.63	11.97	10.98	1.71	14.76	13.38	1.79	17.69	15.50	1.88	20.97	20.97	1.98	24.73	24.73	2.10	29.17	29.17	2.26
	800	6.82	6.27	1.55	9.45	8.70	1.63	12.15	11.15	1.70	14.96	13.57	1.77	17.92	15.70	1.85	21.32	21.32	1.93	25.15	25.15	2.04	29.90	29.90	2.18
	900	6.95	6.39	1.56	9.60	8.83	1.63	12.30	11.29	1.70	15.12	13.72	1.76	18.12	15.88	1.82	21.64	21.64	1.91	25.49	25.49	2.00	30.37	30.37	2.12
75 (23.9)	700	6.18	5.69	1.61	8.87	8.17	1.70	11.61	10.66	1.79	14.45	13.10	1.86	17.41	15.25	1.96	20.62	20.62	2.08	24.33	24.33	2.21	28.68	28.68	2.38
	800	6.33	5.82	1.62	9.05	8.33	1.70	11.80	10.83	1.78	14.65	13.29	1.86	17.63	15.45	1.94	20.92	20.92	2.04	24.72	24.72	2.15	29.30	29.30	2.29
	900	6.46	5.95	1.63	9.20	8.46	1.71	11.96	10.98	1.78	14.82	13.44	1.85	17.82	15.62	1.92	21.17	21.17	2.00	25.06	25.06	2.11	29.87	29.87	2.24

PERFORMANCE DATA (CONT)

030 Cooling Extended Performance Table

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F (°C)																	
		75 (23.9)			85 (25.4)			95 (35)			105 (40.6)			115 (46.1)			125 (51.7)		
		CFM / BF	EWB °F (°C)	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	
Total	Sens			Total	Sens		Total	Sens		Total	Sens		Total	Sens					
875 / 0.09	57 (13.9)	28.90	28.90	1.75	27.66	27.66	1.98	26.34	26.34	2.23	24.91	24.91	2.50	23.31	23.31	2.79	21.49	21.49	3.10
	62 (16.7)	30.13	28.11	1.76	28.62	25.29	1.98	27.03	24.40	2.23	25.33	23.41	2.50	23.49	22.28	2.79	21.49	21.49	3.10
	63* (17.2)	30.53	21.33	1.76	28.98	20.56	1.99	27.34	19.74	2.23	25.59	18.86	2.50	23.67	17.91	2.79	21.53	16.85	3.10
	67 (19.4)	32.87	22.12	1.77	31.20	21.35	2.00	29.40	20.50	2.25	27.48	19.61	2.51	25.38	18.63	2.80	23.04	17.54	3.11
	72 (22.2)	35.81	18.16	1.79	33.93	17.39	2.01	31.94	16.59	2.26	29.81	15.73	2.53	27.48	14.79	2.82	24.87	13.74	3.12
	57 (13.9)	30.18	30.18	1.78	28.85	28.85	2.01	27.42	27.42	2.26	25.86	25.86	2.53	24.13	24.13	2.82	22.16	22.16	3.13
	62 (16.7)	30.95	27.96	1.79	29.37	27.05	2.01	27.71	26.05	2.26	25.93	25.93	2.53	24.13	24.13	2.82	22.15	22.15	3.13
1000 / 0.11	63* (17.2)	31.31	22.62	1.79	29.68	21.82	2.01	27.94	20.96	2.26	26.10	20.04	2.53	24.08	19.03	2.82	21.84	17.91	3.13
	67 (19.4)	33.68	23.51	1.80	31.90	22.68	2.03	30.00	21.80	2.27	27.99	20.86	2.54	25.79	19.83	2.83	23.33	18.68	3.13
	72 (22.2)	36.64	19.00	1.82	34.65	18.20	2.04	32.55	17.36	2.29	30.32	16.46	2.55	27.88	15.48	2.84	25.15	14.38	3.14
	57 (13.9)	31.28	31.28	1.81	29.85	29.85	2.04	28.30	28.30	2.29	26.64	26.64	2.56	24.79	24.79	2.85	22.68	22.68	3.15
	62 (16.7)	31.65	29.65	1.81	30.03	28.60	2.04	28.33	28.33	2.29	26.64	26.64	2.56	24.79	24.79	2.85	22.68	22.68	3.15
	63* (17.2)	31.93	23.86	1.82	30.22	23.02	2.04	28.41	22.12	2.29	26.48	21.16	2.56	24.39	20.11	2.84	22.07	18.92	3.15
	67 (19.4)	34.31	24.83	1.83	32.44	23.96	2.05	30.46	23.04	2.30	28.36	22.06	2.57	26.07	20.98	2.85	23.54	19.76	3.16
72 (22.2)	37.28	19.79	1.84	35.20	18.96	2.07	33.02	18.08	2.31	30.70	17.15	2.58	28.17	16.14	2.87	25.35	14.98	3.17	

*At 75°F (23.9 °C) entering dry bulb—Tennessee Valley Authority [TVA] rating conditions; all others at 80°F (26.7 °C) entering dry bulb. See Legend and Notes.

030 Heating Extended Performance Table -10-60 (-23.3-15.6 °C)

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES °F (°C)																							
		-10 (-23.3)			0 (-17.8)			10 (-12.2)			20 (-6.7)			30 (-1.1)			40 (4.4)			50 (10)			60 (15.6)		
		EDB CFM	Capacity MBtuh	Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW			
Total	Integ				Total	Integ		Total	Integ		Total	Integ		Total	Integ		Total	Integ		Total	Integ				
65 (18.3)	875	10.24	9.42	1.89	12.96	11.93	1.96	15.82	14.52	2.03	18.66	17.10	2.11	22.46	19.68	2.21	26.52	26.52	2.34	31.40	31.40	2.50	36.62	36.62	2.67
	1000	10.40	9.57	1.89	13.12	12.07	1.95	15.99	14.68	2.02	19.06	17.28	2.08	22.77	19.95	2.17	26.86	26.86	2.28	31.83	31.83	2.41	36.62	36.62	2.56
	1125	10.54	9.69	1.90	13.26	12.21	1.96	16.14	14.81	2.01	19.24	17.45	2.07	22.99	20.15	2.15	27.32	27.32	2.25	31.80	31.80	2.36	36.13	36.13	2.51
70 (21.1)	875	9.95	9.15	1.90	12.72	11.70	2.07	15.61	14.33	2.15	18.66	16.92	2.23	22.16	19.42	2.34	26.18	26.18	2.47	30.89	30.89	2.63	36.24	36.24	2.82
	1000	10.10	9.30	2.00	12.88	11.85	2.06	15.78	14.49	2.13	18.85	17.09	2.20	22.42	19.65	2.29	26.52	26.52	2.41	31.49	31.49	2.56	36.36	36.36	2.71
	1125	10.25	9.43	2.01	13.03	11.99	2.06	15.93	14.63	2.12	19.01	17.24	2.19	22.66	19.85	2.27	26.83	26.83	2.37	31.59	31.59	2.49	36.06	36.06	2.64
75 (23.9)	875	9.62	8.85	2.08	12.45	11.46	2.18	15.39	14.12	2.27	18.46	16.75	2.36	21.88	19.17	2.47	25.86	25.86	2.61	30.41	30.41	2.78	35.88	35.88	2.98
	1000	9.78	9.00	2.10	12.62	11.61	2.17	15.56	14.29	2.25	18.64	16.91	2.33	22.13	19.39	2.42	26.18	26.18	2.54	31.01	31.01	2.69	36.05	36.05	2.86
	1125	9.93	9.13	2.11	12.77	11.75	2.18	15.72	14.43	2.24	18.81	17.06	2.31	22.35	19.59	2.40	26.45	26.45	2.50	31.31	31.31	2.63	35.91	35.91	2.79

PERFORMANCE DATA (CONT) 036 Cooling Extended Performance Table

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F (°C)																	
		75 (23.9)			85 (29.4)			95 (35)			105 (40.6)			115 (46.1)			125 (51.7)		
		CFM / BF	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW		
Total	Sens		Total	Sens		Total	Sens		Total	Sens		Total	Sens						
1050 / 0.10	57 (13.9)	34.34	34.34	2.43	32.89	32.89	2.70	31.31	31.31	3.00	29.62	29.62	3.32	27.74	27.74	3.67	25.60	25.60	4.04
	62 (16.7)	35.46	31.44	2.44	33.72	30.48	2.71	31.86	29.41	3.00	29.90	28.20	3.32	27.78	27.78	3.67	25.60	25.60	4.04
	63* (17.2)	35.90	25.45	2.44	34.11	24.56	2.71	32.19	23.62	3.00	30.13	22.58	3.33	27.89	21.47	3.67	25.40	20.22	4.03
	67 (19.4)	38.75	26.48	2.45	36.81	25.59	2.73	34.73	24.61	3.02	32.51	23.58	3.34	30.08	22.45	3.69	27.36	21.16	4.06
	72 (22.2)	42.32	21.50	2.47	40.19	20.65	2.74	37.90	19.72	3.04	35.47	18.74	3.37	32.79	17.67	3.71	29.77	16.45	4.08
	57 (13.9)	35.80	35.80	2.49	34.24	34.24	2.76	32.54	32.54	3.06	30.71	30.71	3.38	28.69	28.69	3.73	26.39	26.39	4.10
	62 (16.7)	36.38	33.64	2.49	34.58	32.55	2.76	32.84	32.84	3.06	30.72	30.72	3.38	28.69	28.69	3.73	26.39	26.39	4.10
1200 / 0.11	63* (17.2)	36.74	27.00	2.50	34.86	26.09	2.77	32.83	25.08	3.06	30.68	24.01	3.38	28.34	22.84	3.73	25.74	21.56	4.09
	67 (19.4)	39.63	28.16	2.51	37.58	27.22	2.78	35.40	26.20	3.08	33.08	25.12	3.40	30.53	23.93	3.75	27.69	22.58	4.11
	72 (22.2)	43.25	22.51	2.53	41.00	21.61	2.80	38.80	20.65	3.10	36.05	19.63	3.42	33.25	18.51	3.77	30.11	17.24	4.14
	57 (13.9)	37.03	37.03	2.55	35.36	35.36	2.82	33.56	33.56	3.12	31.61	31.61	3.44	29.46	29.46	3.79	27.01	27.01	4.16
	62 (16.7)	37.21	35.56	2.55	35.38	35.38	2.82	33.56	33.56	3.12	31.61	31.61	3.44	29.46	29.46	3.79	27.01	27.01	4.16
	63* (17.2)	37.39	28.51	2.55	35.42	27.54	2.82	33.32	26.50	3.12	31.09	25.39	3.44	28.67	24.15	3.78	25.98	22.75	4.15
	67 (19.4)	40.30	29.77	2.57	38.17	28.78	2.84	35.89	27.73	3.13	33.48	26.60	3.46	30.85	25.34	3.80	27.92	23.90	4.17
72 (22.2)	43.95	23.46	2.58	41.61	22.52	2.86	39.12	21.53	3.15	36.47	20.47	3.48	33.57	19.30	3.82	30.33	17.98	4.19	

*At 75°F (23.9 °C) entering dry bulb—Tennessee Valley Authority [TVA] rating conditions; all others at 80°F (26.7 °C) entering dry bulb. See Legend and Notes.

036 Heating Extended Performance Table -10-60 (-23.3-15.6 °C)

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES °F (°C)																							
		-10 (-23.3)			0 (-17.8)			10 (-12.2)			20 (-6.7)			30 (-1.1)			40 (4.4)			50 (10)			60 (15.6)		
		EDB CFM	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW		
Total	Integ		Total	Integ		Total	Integ		Total	Integ		Total	Integ		Total	Integ		Total	Integ		Total	Integ			
65 (18.3)	1050	11.73	10.79	2.28	15.19	13.97	2.37	18.75	17.21	2.46	22.49	20.40	2.55	26.57	23.28	2.64	31.32	31.32	2.76	37.01	37.01	2.91	43.24	43.24	3.08
	1200	12.00	11.04	2.32	15.47	14.23	2.40	19.05	17.48	2.47	23.59	21.39	2.57	26.97	23.63	2.63	31.80	31.80	2.73	37.80	37.80	2.86	43.34	43.34	3.00
	1350	12.24	11.26	2.36	15.72	14.46	2.43	19.31	17.72	2.50	23.08	20.93	2.56	27.31	23.93	2.63	32.38	32.38	2.73	37.86	37.86	2.83	42.60	42.60	2.96
70 (21.1)	1050	11.19	10.30	2.38	14.74	13.57	2.48	18.38	16.87	2.58	22.16	20.10	2.67	26.17	22.93	2.77	30.86	30.86	2.90	36.34	36.34	3.05	42.74	42.74	3.23
	1200	11.47	10.55	2.41	15.03	13.83	2.50	18.68	17.14	2.59	22.48	20.38	2.67	26.55	23.26	2.76	31.33	31.33	2.87	37.15	37.15	3.00	42.95	42.95	3.15
	1350	11.71	10.77	2.45	15.29	14.07	2.54	18.94	17.39	2.61	22.76	20.64	2.68	26.89	23.56	2.76	31.74	31.74	2.86	37.56	37.56	2.97	42.55	42.55	3.11
75 (23.9)	1050	10.59	9.75	2.46	14.25	13.11	2.58	17.96	16.49	2.69	21.80	19.77	2.80	25.82	22.82	2.91	30.32	30.32	3.04	35.69	35.69	3.20	42.20	42.20	3.39
	1200	10.87	10.00	2.50	14.55	13.38	2.61	18.27	16.77	2.71	22.12	20.06	2.80	26.17	22.93	2.89	30.87	30.87	3.01	36.51	36.51	3.15	42.50	42.50	3.30
	1350	11.12	10.23	2.54	14.81	13.63	2.64	18.54	17.02	2.73	22.41	20.32	2.81	26.48	23.20	2.89	31.27	31.27	3.00	37.16	37.16	3.11	42.34	42.34	3.26

PERFORMANCE DATA (CONT)

042 Cooling Extended Performance Table

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F (°C)																	
		75 (23.9)			85 (29.4)			95 (35)			105 (40.6)			115 (46.1)			125 (51.7)		
		CFM / BF	EWB °F (°C)	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	
Total	Sens			Total	Sens		Total	Sens		Total	Sens		Total	Sens					
1225 / 0.11	57 (13.9)	39.94	39.94	2.84	38.16	38.16	3.15	36.22	36.22	3.50	34.10	34.10	3.87	31.73	31.73	4.28	28.99	28.99	4.71
	62 (16.7)	41.11	36.17	2.85	34.98	34.98	3.16	36.71	33.68	3.51	34.30	32.21	3.88	31.74	31.74	4.28	28.99	28.99	4.71
	63* (17.2)	41.60	29.27	2.86	28.21	28.21	3.17	37.08	27.07	3.51	34.57	25.84	3.88	31.82	24.50	4.28	28.71	22.97	4.70
	67 (19.4)	44.73	30.39	2.90	29.30	29.30	3.22	39.80	28.14	3.56	37.07	26.89	3.93	34.05	25.51	4.32	30.64	23.94	4.74
	72 (22.2)	48.66	24.63	2.96	46.04	23.59	3.27	43.23	22.48	3.61	40.21	21.29	3.98	36.88	19.97	4.38	33.11	18.48	4.79
1400 / 0.12	57 (13.9)	41.58	41.58	2.91	39.65	39.65	3.22	37.54	37.54	3.57	35.26	35.26	3.94	32.70	32.70	4.35	29.75	29.75	4.77
	62 (16.7)	42.15	38.67	2.92	39.93	37.33	3.23	37.58	37.58	3.57	35.26	35.26	3.94	32.70	32.70	4.35	29.74	29.74	4.77
	63* (17.2)	42.55	31.08	2.92	40.24	29.96	3.23	37.77	28.76	3.57	35.14	27.47	3.94	32.26	26.06	4.34	29.01	24.43	4.76
	67 (19.4)	45.70	32.32	2.96	43.19	31.18	3.28	40.50	29.95	3.62	37.64	28.64	3.99	34.47	27.19	4.38	30.90	25.51	4.80
	72 (22.2)	49.66	25.79	3.02	46.91	24.70	3.33	43.97	23.54	3.67	40.82	22.30	4.04	37.33	20.92	4.43	33.44	19.38	4.85
1575 / 0.13	57 (13.9)	42.95	42.95	2.97	40.89	40.89	3.29	38.84	38.84	3.63	36.20	36.20	4.01	33.47	33.47	4.41	30.34	30.34	4.84
	62 (16.7)	43.02	43.02	2.97	40.89	40.89	3.29	38.84	38.84	3.63	36.20	36.20	4.01	33.47	33.47	4.41	30.34	30.34	4.84
	63* (17.2)	43.27	32.81	2.98	40.87	31.64	3.29	38.29	30.38	3.63	35.56	29.03	3.99	32.57	27.53	4.39	29.22	25.77	4.81
	67 (19.4)	46.44	34.17	3.02	43.82	32.97	3.33	41.01	31.69	3.67	38.05	30.33	4.04	34.76	28.78	4.44	31.10	26.99	4.85
	72 (22.2)	50.43	26.88	3.08	47.56	25.75	3.39	44.51	24.55	3.73	41.26	23.27	4.10	37.64	21.83	4.49	33.62	20.21	4.90

*At 75°F (23.9 °C) entering dry bulb—Tennessee Valley Authority [TVA] rating conditions; all others at 80°F (26.7 °C) entering dry bulb. See Legend and Notes.

042 Heating Extended Performance Table -10-60 (-23.3-15.6 °C)

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES °F (°C)																							
		-10 (-23.3)			0 (-17.8)			10 (-12.2)			20 (-6.7)			30 (-1.1)			40 (4.4)			50 (10)			60 (15.6)		
		EDB CFM	Capacity MBtuh	Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW	Capacity MBtuh		Total Sys KW			
Total	Integ				Total	Integ		Total	Integ		Total	Integ		Total	Integ		Total	Integ		Total	Integ				
65 (18.3)	1225	13.51	12.43	2.46	17.40	16.01	2.58	21.46	19.70	2.69	25.77	23.37	2.82	30.59	28.90	3.14	36.13	36.13	3.35	42.42	42.42	3.35	49.90	49.90	3.61
	1400	13.76	12.66	2.49	17.66	16.25	2.59	21.74	19.95	2.69	26.08	23.68	2.81	30.99	27.16	2.93	36.61	36.61	3.09	43.03	43.03	3.29	50.17	50.17	3.51
	1575	13.98	12.86	2.52	17.89	16.46	2.61	21.98	20.17	2.71	26.36	23.91	2.81	31.34	27.46	2.92	37.00	37.00	3.07	43.64	43.64	3.25	50.02	50.02	3.46
	1225	12.97	11.93	2.58	16.94	15.58	2.70	21.06	19.33	2.83	25.39	23.02	2.97	30.16	26.42	3.12	35.61	35.61	3.30	41.80	41.80	3.52	49.25	49.25	3.79
	1400	13.21	12.16	2.61	17.21	15.83	2.72	21.34	19.59	2.83	25.71	23.32	2.95	30.53	26.75	3.09	36.09	36.09	3.25	42.39	42.39	3.45	49.66	49.66	3.69
70 (21.1)	1575	13.44	12.37	2.64	17.44	16.05	2.74	21.59	19.82	2.84	25.98	23.57	2.95	30.86	27.04	3.07	36.48	36.48	3.23	42.89	42.89	3.42	49.65	49.65	3.63
	1225	12.87	11.38	2.70	16.44	15.13	2.84	20.82	18.93	2.97	24.99	22.67	3.12	29.75	26.06	3.28	34.97	34.97	3.46	41.20	41.20	3.70	48.49	48.49	3.99
75 (23.9)	1400	12.92	11.61	2.73	16.71	15.37	2.85	20.91	19.19	2.98	25.30	22.94	3.10	30.11	26.38	3.25	35.45	35.45	3.41	41.78	41.78	3.62	49.11	49.11	3.87
	1575	12.85	11.82	2.76	16.95	15.60	2.87	21.17	19.43	2.99	25.59	23.21	3.10	30.43	26.67	3.23	35.97	35.97	3.39	42.25	42.25	3.58	49.22	49.22	3.80

PERFORMANCE DATA (CONT)
048 Cooling Extended Performance Table

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F (°C)																	
		75 (23.9)			85 (29.4)			95 (35)			105 (40.6)			115 (46.1)			125 (51.7)		
		EWB of CFM / BF	Capacity MBtuh	Total Sys KW	Capacity MBtuh	Total Sys KW	Capacity MBtuh	Total Sys KW	Capacity MBtuh	Total Sys KW	Capacity MBtuh	Total Sys KW	Capacity MBtuh	Total Sys KW	Capacity MBtuh	Total Sys KW	Capacity MBtuh	Total Sys KW	
Sens	Total																		Sens
57 (13.9)	47.01	3.24	44.84	3.63	42.49	4.06	39.97	4.51	37.16	4.99	33.94	5.49	33.94	5.49	33.94	5.49	33.94		
62 (16.7)	48.48	3.24	45.86	3.64	43.09	4.06	40.20	4.51	37.17	4.99	33.93	5.49	33.93	5.49	33.93	5.49	33.93		
63* (17.2)	49.15	3.25	46.45	3.64	43.59	4.06	40.57	4.51	37.30	4.99	33.63	5.49	33.63	5.49	33.63	5.49	33.63		
67 (19.4)	52.83	3.25	49.88	3.65	46.73	4.07	43.45	4.53	39.85	5.01	35.81	5.51	35.81	5.51	35.81	5.51	35.81		
72 (22.2)	57.57	3.25	54.28	3.66	50.79	4.09	47.12	4.54	43.10	5.02	38.58	5.52	38.58	5.52	38.58	5.52	38.58		
57 (13.9)	48.95	3.30	46.57	3.69	44.01	4.12	41.28	4.57	38.25	5.05	34.77	5.55	34.77	5.55	34.77	5.55	34.77		
62 (16.7)	49.68	3.30	46.94	3.69	44.06	4.12	41.28	4.57	38.25	5.05	34.77	5.55	34.77	5.55	34.77	5.55	34.77		
63* (17.2)	50.24	3.30	47.38	3.70	44.36	4.12	41.19	4.57	37.76	5.05	33.94	5.55	33.94	5.55	33.94	5.55	33.94		
67 (19.4)	53.94	3.30	50.82	3.70	47.50	4.13	44.07	4.59	40.28	5.06	36.08	5.56	36.08	5.56	36.08	5.56	36.08		
72 (22.2)	58.71	3.31	55.23	3.71	51.56	4.14	47.71	4.60	43.51	5.08	38.73	5.57	38.73	5.57	38.73	5.57	38.73		
57 (13.9)	50.56	3.35	48.01	3.75	45.26	4.18	42.34	4.63	39.11	5.11	35.42	5.61	35.42	5.61	35.42	5.61	35.42		
62 (16.7)	50.66	3.35	48.01	3.75	45.26	4.18	42.34	4.63	39.11	5.11	35.42	5.61	35.42	5.61	35.42	5.61	35.42		
63* (17.2)	51.06	3.36	48.08	3.75	44.92	4.18	41.64	4.63	38.08	5.11	34.14	5.60	34.14	5.60	34.14	5.60	34.14		
67 (19.4)	54.78	3.36	51.51	3.76	48.05	4.19	44.48	4.64	40.56	5.12	36.20	5.62	36.20	5.62	36.20	5.62	36.20		
72 (22.2)	59.55	3.36	55.92	3.77	52.13	4.20	48.12	4.65	43.77	5.13	39.37	5.64	39.37	5.64	39.37	5.64	39.37		

*At 75°F (23.9 °C) entering dry bulb—Tennessee Valley Authority [TVA] rating conditions; all others at 80°F (26.7 °C) entering dry bulb. See Legend and Notes.

048 Heating Extended Performance Table -10-60 (-23.3-15.6 °C)

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES °F (°C)																							
		-10 (-23.3)			0 (-17.8)			10 (-12.2)			20 (-6.7)			30 (-1.1)			40 (4.4)			50 (10)			60 (15.6)		
		EDB CFM	Capacity MBtuh	Total Sys KW	Capacity MBtuh	Total Sys KW	Capacity MBtuh	Total Sys KW	Capacity MBtuh	Total Sys KW	Capacity MBtuh	Total Sys KW	Capacity MBtuh	Total Sys KW	Capacity MBtuh	Total Sys KW	Capacity MBtuh	Total Sys KW	Capacity MBtuh	Total Sys KW	Capacity MBtuh	Total Sys KW	Capacity MBtuh	Total Sys KW	
Total	Integ																								Total
65 (16.3)	16.44	15.13	3.02	20.84	19.18	3.12	25.52	23.43	3.22	30.51	27.67	3.33	35.89	31.45	3.45	41.90	41.30	3.59	49.06	49.06	3.77	56.77	56.77	3.95	
70 (21.1)	16.73	15.39	3.05	21.15	19.46	3.14	25.88	23.75	3.23	30.86	27.99	3.32	36.29	31.80	3.42	42.54	42.54	3.54	49.82	49.82	3.67	56.93	56.93	3.82	
75 (23.9)	17.00	15.64	3.09	21.43	19.72	3.17	26.19	24.04	3.24	31.18	28.28	3.32	36.64	32.10	3.41	43.01	43.01	3.51	49.98	49.98	3.62	56.73	56.73	3.75	
1400	15.87	14.60	3.15	20.34	18.72	3.27	25.03	22.97	3.38	30.09	27.29	3.50	35.46	31.07	3.63	41.32	41.32	3.78	48.38	48.38	3.97	56.17	56.17	4.16	
1800	16.16	14.87	3.18	20.66	19.01	3.29	25.39	23.30	3.39	30.46	27.62	3.49	35.87	31.43	3.69	41.85	41.85	3.72	49.21	49.21	3.87	56.40	56.40	4.03	
1400	16.43	15.11	3.22	20.94	19.26	3.31	25.71	23.59	3.40	30.79	27.92	3.49	36.22	31.74	3.59	42.32	42.32	3.69	49.53	49.53	3.81	56.34	56.34	3.96	
1800	15.25	14.03	3.29	19.81	18.22	3.42	24.56	22.54	3.54	29.64	26.88	3.68	35.01	30.67	3.82	40.77	40.77	3.97	47.74	47.74	4.17	55.56	55.56	4.38	
1400	15.54	14.30	3.32	20.13	18.52	3.44	24.90	22.85	3.55	30.02	27.23	3.66	35.43	31.04	3.78	41.27	41.27	3.91	48.40	48.40	4.08	55.88	55.88	4.25	
1800	15.81	14.55	3.36	20.41	18.78	3.46	25.20	23.13	3.56	30.35	27.52	3.66	35.79	31.36	3.77	41.72	41.72	3.88	49.03	49.03	4.02	55.89	55.89	4.17	

PERFORMANCE DATA (CONT)

060 Cooling Extended Performance Table

EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES °F (°C)											
		75 (23.9)		85 (29.4)		95 (35)		105 (40.6)		115 (46.1)		125 (51.7)	
		Capacity MBtuh Total	Sens	Total Sys KW	Capacity MBtuh Total	Sens	Total Sys KW	Capacity MBtuh Total	Sens	Total Sys KW	Capacity MBtuh Total	Sens	Total Sys KW
65 (18.3)	57 (13.9)	58.60	55.29	3.94	4.41	51.87	48.29	4.94	5.52	44.45	40.24	6.15	6.83
	62 (16.7)	60.21	56.43	3.96	4.43	52.55	48.58	4.95	5.52	44.47	40.24	6.15	6.83
70 (21.1)	63* (17.2)	60.88	42.10	3.96	4.43	52.99	37.41	4.95	5.52	44.50	33.46	6.15	6.82
	67 (19.4)	65.54	43.78	4.01	4.48	57.00	39.00	5.00	5.57	47.74	34.92	6.20	6.87
75 (23.9)	72 (22.2)	71.35	35.37	4.07	4.54	61.92	30.75	5.06	5.63	51.67	26.86	6.25	6.92
	57 (13.9)	60.94	60.94	4.05	4.52	53.74	49.91	5.04	5.62	45.81	41.30	6.25	6.93
2000 / 0.13	62 (16.7)	61.69	55.65	4.05	4.52	53.82	49.91	5.05	5.62	45.81	41.30	6.25	6.93
	63* (17.2)	62.19	44.67	4.06	4.53	53.95	39.68	5.05	5.62	45.10	35.53	6.24	6.92
2250 / 0.14	67 (19.4)	66.90	46.52	4.11	4.58	57.96	41.44	5.10	5.67	48.31	37.11	6.29	6.96
	72 (22.2)	72.75	37.00	4.17	4.64	62.92	32.17	5.16	5.73	52.26	28.12	6.35	7.01
2500 / 0.15	57 (13.9)	62.90	62.90	4.15	4.62	55.27	51.22	5.15	5.73	46.87	42.10	6.36	7.03
	62 (16.7)	63.01	59.16	4.15	4.62	55.28	51.22	5.15	5.73	46.87	42.10	6.36	7.03
2750 / 0.16	63* (17.2)	63.19	47.09	4.15	4.62	54.66	43.80	5.14	5.71	45.53	37.46	6.34	7.01
	67 (19.4)	67.92	49.16	4.20	4.67	58.67	45.74	5.19	5.76	48.70	39.27	6.38	7.05
2900 / 0.17	72 (22.2)	73.82	38.53	4.26	4.73	63.65	33.51	5.25	5.82	52.67	29.30	6.44	7.10

*At 75°F (23.9 °C) entering dry bulb—Tennessee Valley Authority [TVA] rating conditions; all others at 80°F (26.7 °C) entering dry bulb. See Legend and Notes.

060 Heating Extended Performance Table -10-60 (-23.3-15.6 °C)

INDOOR AIR		OUTDOOR COIL ENTERING AIR TEMPERATURES °F (°C)																							
		-10 (-23.3)		0 (-17.8)		10 (-12.2)		20 (-6.7)		30 (-1.1)		40 (4.4)		50 (10)		60 (15.6)									
		Capacity MBtuh Total	Sens	Total Sys KW	Capacity MBtuh Total	Sens	Total Sys KW	Capacity MBtuh Total	Sens	Total Sys KW	Capacity MBtuh Total	Sens	Total Sys KW	Capacity MBtuh Total	Sens	Total Sys KW									
65 (18.3)	1750	20.22	18.60	3.60	25.38	3.71	30.81	28.28	3.83	36.70	33.28	3.96	43.20	37.86	4.12	50.69	50.69	4.31	59.27	59.27	4.53	68.07	68.07	4.79	
	2000	20.60	18.95	3.65	25.77	23.72	3.75	31.22	28.66	3.85	37.17	33.71	3.97	43.77	38.35	4.10	51.37	51.37	4.27	59.59	59.59	4.44	67.77	67.77	4.66
70 (21.1)	1750	19.58	18.02	3.78	24.85	22.86	3.90	30.34	27.85	4.03	36.22	32.85	4.17	42.74	37.45	4.33	50.07	50.07	4.48	58.54	58.54	4.76	67.38	67.38	5.03
	2000	19.97	18.37	3.83	25.25	23.23	3.94	30.76	28.23	4.05	36.71	33.29	4.17	43.27	37.91	4.31	50.72	50.72	4.48	59.05	59.05	4.67	67.36	67.36	4.90
75 (23.9)	1750	18.88	17.37	3.95	24.26	22.32	4.09	29.84	27.39	4.23	35.72	32.40	4.38	42.24	37.01	4.55	49.27	49.27	4.75	57.69	57.69	5.01	66.69	66.69	5.28
	2000	19.27	17.73	4.01	24.67	22.70	4.13	30.27	27.78	4.25	36.21	32.84	4.38	42.78	37.48	4.53	49.95	49.95	4.70	58.48	58.48	4.90	66.85	66.85	5.14
2250	19.82	18.05	4.07	25.04	23.04	4.17	30.65	28.13	4.28	36.65	33.24	4.40	43.25	37.89	4.53	50.66	50.66	4.69	58.60	58.60	4.86	66.06	66.06	5.06	

LEGEND

- BF — Bypass Factor
- edb — Entering Dry – Bulb
- EWb — Entering Wet – Bulb
- kw — Total Unit Power Input
- SHC — Sensible Heat Capacity (1000 Btuh)
- TC — Total Capacity (1000 Btuh) (net)
- rh — Relative Humidity

COOLING NOTES:

1. Ratings are net; they account for the effects of the evaporator – fan motor power and heat.
2. Direct interpolation is permissible. Do not extrapolate.
3. The following formulas may be used:

$$t_{db} = t_{edb} - \frac{\text{Sensible capacity (Btuh)}}{1,10 \times \text{cfm}}$$

$$t_{wb} = \text{Wet-bulb temperature corresponding to enthalpy of air leaving evaporator coil (} t_{lwb} \text{)}$$

$$h_{lwb} = h_{ewb} - \frac{\text{total capacity (Btuh)}}{4.5 \times \text{cfm}}$$

Where: h_{ewb} = Enthalpy of air entering evaporator coil

4. The SHC is based on 80°F (26.7 °C) edb temperature of air entering evaporator coil. Below 80°F (26.7°C) edb, subtract (corr factor x cfm) from SHC. Above 80°F (26.7°C) edb, add (corr factor x cfm) to SHC.

5. Integrated capacity is maximum (instantaneous) capacity less the effect of frost on the outdoor coil and the heat required to defrost it.

PERFORMANCE DATA (CONT)

Wet Coil Air Delivery 50EZ036-060 - Downflow Discharge - High Speed

Unit		External Static Pressure (IN. W.C.)									
		0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9	1.0
50EZ036	CFM	1527	1466	1401	1339	1274	1228	1187	1142	1098	1065
50EZ042	CFM	1630	1593	1556	1526	1487	1442	1405	1365	1322	1288
50EZ048	CFM	2286	2222	2144	2068	1986	1905	1820	1737	1635	1531
50EZ060	CFM	2113	2049	1979	1911	1840	1771	1681	1614	1524	1418

* Air delivery values are without air filter and are for wet coil.

Note: Deduct field-supplied air filter pressure drop to obtain external static pressure available for ducting.

Economizer 1-in. Filter Pressure Drop (in. wc)

UNIT50EZ	PRESSURE DROP
024-036	0.20
042-060	0.25

Multiplication Factors

HEATER KW RATING	VOLTAGE DISTRIBUTION	MULTIPLICATION FACTOR
240	200	0.69
	208	0.75
	230	0.92
	240	1.00
	460	0.92
480		

LEGEND

- BF — Bypass Factor
- edb — Entering Dry-Bulb
- Ewb — Entering Wet-Bulb
- kW — Total Unit Power Input
- SHC — Sensible Heat Capacity (1000 Btuh)
- TC — Total Capacity (1000 Btuh) (net)
- rh — Relative Humidity

$$t_{lwb} = \text{Wet-bulb temperature corresponding to enthalpy air leaving evaporator coil } (t_{lwb})$$

$$h_{lwb} = \frac{\text{total capacity (Btuh)}}{4.5 \times \text{cfm}}$$

Where: h_{ewb} = Enthalpy of air entering evaporator coil

COOLING NOTES:

1. Ratings are net; they account for the effects of the evaporator-fan motor power and heat.
2. Direct interpolation is permissible. Do not extrapolate.
3. The following formulas may be used:

4. The SHC is based on 805 F (26.6°C) edb temperature of air entering evaporator coil. Below 805 F (26.6°C) edb, subtract (corr factor x cfm) from SHC. Above 80°F (26.6°C) edb, add (corr factor x cfm) to SHC. Correction Factor = 1.10 x (1 + BF) x (edb + 80).

5. Integrated capacity is maximum (instantaneous) capacity less the effect of frost on the outdoor coil and the heat required to defrost it.

$$t_{fdb} = t_{edb} - \frac{\text{Sensible capacity (Btuh)}}{1.10 \times \text{cfm}}$$

Electric Heat Pressure Drop Table

Small Cabinet: 024-036 cfm

	500	600	700	800	900	1000	1100	1200	1300	1400	1500	1600
5kw	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.02	0.03	0.04	0.06
7.5 kw	0.00	0.00	0.00	0.00	0.00	0.00	0.02	0.03	0.05	0.07	0.08	0.09
10 kw	0.00	0.00	0.00	0.00	0.00	0.02	0.04	0.06	0.07	0.09	0.10	0.11
15 kw	0.00	0.00	0.00	0.02	0.04	0.06	0.08	0.10	0.12	0.14	0.16	0.18
20 kw	0.00	0.00	0.02	0.04	0.06	0.08	0.09	0.11	0.13	0.15	0.17	0.19

Electric Heat Pressure Drop Table (in. wc)

Large Cabinet 042-060 cfm

	1100	1200	1300	1400	1500	1600	1700	1800	1900	2000	2100	2200	2300	2400	2500
5kw	0.00	0.00	0.00	0.01	0.02	0.03	0.04	0.05	0.06	0.07	0.08	0.09	0.10	0.11	0.12
7.5 kw	0.00	0.00	0.01	0.02	0.03	0.04	0.05	0.06	0.07	0.08	0.09	0.10	0.11	0.12	0.13
10 kw	0.00	0.00	0.01	0.02	0.03	0.04	0.05	0.06	0.07	0.08	0.09	0.10	0.11	0.12	0.13
15 kw	0.00	0.02	0.03	0.04	0.05	0.06	0.07	0.08	0.09	0.10	0.11	0.12	0.13	0.14	0.15
20 kw	0.02	0.03	0.04	0.05	0.06	0.07	0.08	0.09	0.10	0.11	0.12	0.13	0.14	0.15	0.16

50EZ Wet Coil Pressure Drop

Unit Size	Standard CFM (S.C.F.M)															
	600	700	800	900	1000	1100	1200	1300	1400	1500	1600	1700	1800	1900	2000	
024	0.06	0.07	0.08	0.09	0.1											
030			0.12	0.15	0.19	0.23	0.27									
036					0.07	0.11	0.18	0.26	0.35							
042							0.04	0.07	0.1	0.15	0.21					
048									0.11	0.14	0.17	0.22	0.28			
060											0.1	0.17	0.23	0.31	0.36	

Filter Pressure Drop Table (IN. W.C.)

FILTER SIZE in. (mm)	CFM																		
	500	600	700	800	900	1000	1100	1200	1300	1400	1500	1600	1700	1800	1900	2000	2100	2200	2300
20X20X1 (508X508X25)	0.05	0.07	0.08	0.1	0.12	0.13	0.14	0.15	—	—	—	—	—	—	—	—	—	—	—
20X24X1 (508X610X25)	—	—	—	—	0.09	0.10	0.11	0.13	0.14	0.15	0.16	—	—	—	—	—	—	—	—
24X30X1 (610X762X25)	—	—	—	0.04	0.05	0.06	0.07	0.07	0.08	0.09	0.1	—	—	—	—	—	—	—	—
24X36X1 (610X914X25)	—	—	—	—	—	—	—	0.06	0.07	0.07	0.08	0.09	0.09	0.10	0.11	0.12	0.13	0.14	0.14

50EZ

Dry Coil Air Delivery* - Horizontal and Downflow Discharge - Unit 50EZ024-060

Unit	Motor Speed	Wire Color		External Static Pressure (IN. W.C.)								
				0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
50EZ02431	Low	Blue	CFM	741	638	547	415	--	--	--	--	--
	Med-Low ¹	Pink	CFM	898	820	738	662	536	--	--	--	--
	Medium	Red	CFM	973	887	823	733	665	538	451	--	--
	Med-High	Orange	CFM	1140	1064	996	915	840	758	687	564	480
50EZ03031,51	High	Black	CFM	1202	1140	1082	1015	961	881	810	732	631
	Low	Blue	CFM	741	638	547	415	--	--	--	--	--
	Med-Low ¹	Pink	CFM	898	820	738	662	536	--	--	--	--
	Medium	Red	CFM	973	887	823	733	665	538	451	--	--
50EZ03631,51,60	Med-High ¹	Orange	CFM	1140	1064	996	915	840	758	687	564	480
	High	Black	CFM	1202	1140	1082	1015	961	881	810	732	631
	Low	Blue	CFM	1206	1151	1085	1033	961	901	839	769	694
	Med-Low ¹	Pink	CFM	1369	1317	1262	1208	1152	1095	1037	979	919
50EZ04231,51,60	Medium	Red	CFM	1419	1370	1315	1269	1209	1161	1101	1043	984
	Med-High	Orange	CFM	1557	1507	1464	1412	1365	1310	1265	1212	1154
	High	Black	CFM	1599	1553	1505	1460	1410	1361	1310	1262	1203
	Low	Blue	CFM	1295	1234	1182	1126	1075	1016	955	898	857
50EZ04831,51,60	Med-Low ¹	Pink	CFM	1345	1282	1235	1194	1140	1095	1027	974	921
	Medium	Red	CFM	1505	1452	1413	1358	1323	1282	1234	1169	1130
	Med-High ¹	Orange	CFM	1545	1492	1449	1411	1362	1313	1278	1231	1188
	High	Black	CFM	1705	1643	1607	1568	1518	1483	1448	1404	1360
50EZ06031,51,60	Low	Blue	CFM	1445	1389	1341	1281	1236	1189	1139	1072	1027
	Med-Low ¹	Pink	CFM	1678	1635	1602	1558	1513	1474	1438	1404	1349
	Medium	Red	CFM	1962	1915	1880	1843	1794	1753	1711	1675	1628
	Med-High	Orange	CFM	2131	2088	2065	2013	1982	1941	1888	1860	1785
50EZ06031,51,60	High	Black	CFM	2461	2409	2339	2286	2192	2140	2062	1968	1874
	Low	Blue	CFM	1448	1321	1282	1235	1192	1145	1101	1057	1011
	Med-Low	Pink	CFM	1722	1675	1614	1543	1499	1442	1408	1356	1308
	Medium ¹	Red	CFM	1887	1847	1783	1726	1677	1625	1578	1527	1432
50EZ06031,51,60	Med-High	Orange	CFM	2055	2008	1958	1927	1900	1768	1685	1581	1458
	High	Black	CFM	2292	2238	2158	2049	1935	1840	1732	1635	1513


* Air delivery values are without air filter and are for dry coil (See 50EZ Wet Coil Pressure Drop Table).

¹ Factory-shipped cooling speed

NOTE: Deduct field-supplied air filter pressure drop and wet coil pressure drop to obtain external static pressure available for ducting.

50EZ


TYPICAL PIPING AND WIRING

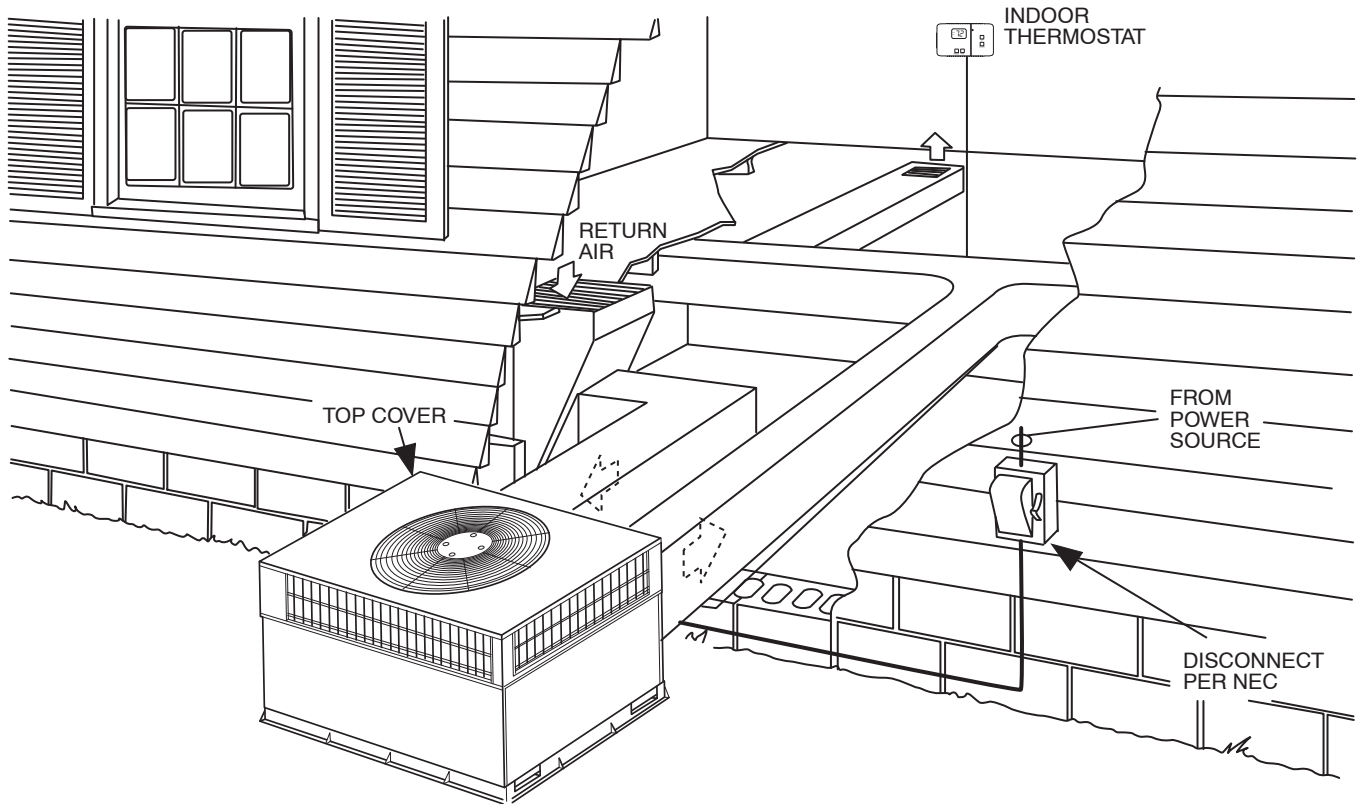

C99061

APPLICATION DATA

Condensate trap — A 2-in. (51 mm) condensate trap must be field supplied.

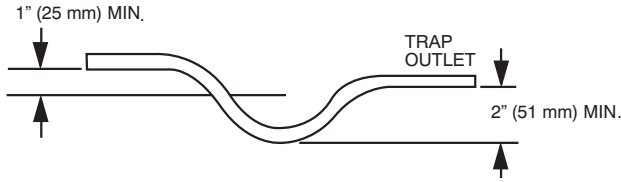

A08001

Ductwork — Secure downflow discharge ductwork to roof curb. For horizontal discharge applications, attach ductwork to unit with flanges.

To convert a unit to downflow discharge — Units are equipped with factory-installed inserts in the downflow openings. Removal of the inserts is similar to removing an electrical knock-out. Units installed in horizontal discharge orientation do not require duct covers.

Maximum cooling airflow — To minimize the possibility of condensate blow-off from the evaporator, airflow through the units should not exceed 450 cfm per ton.


Minimum cooling airflow — Minimum cooling airflow is 350 cfm per ton in cooling mode. Airflow can be lower in certain modes when humidity removal is an issue.

Minimum ambient cooling operation temperature — All standard units have a minimum cooling operating temperature of 40°F (4.4°C). With accessory low ambient temperature kit, units can operate at temperatures down to 0°F (17.8°C).

Maximum operating outdoor air temperature for cooling is 125°F (51.7°C).

50EZ

BALANCE POINT WORKSHEET

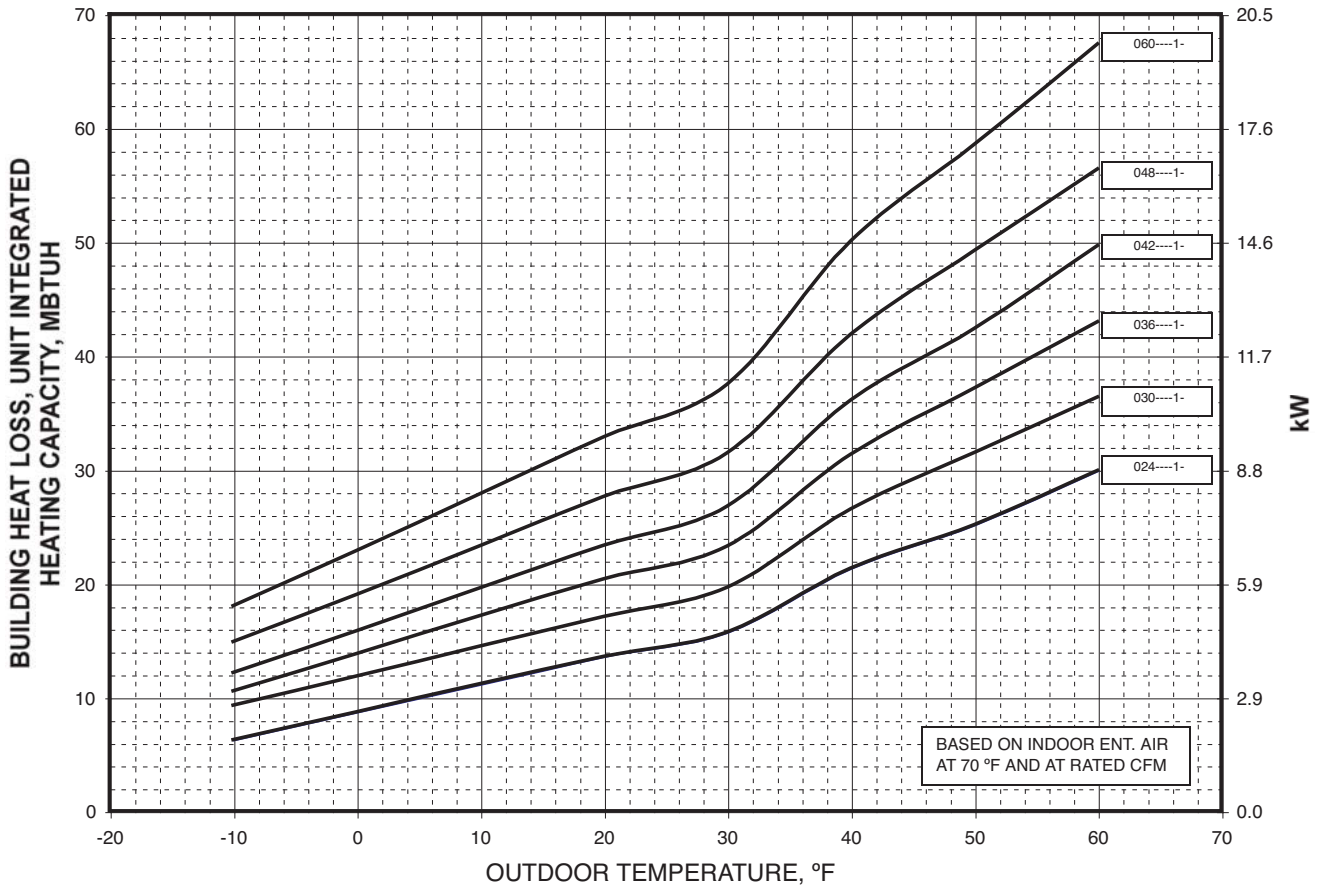

A08239

ELECTRICAL DATA

50EZ Electrical Data

50EZ


UNIT	NOMINAL V-PH-HZ	VOLTAGE RANGE		COMPRESSOR RLA	LRA	OFM	IFM	ELECTRIC HEAT		POWER SUPPLY		
		MIN	MAX			FLA	FLA	NOMINAL KW	FLA	MCA	FUSE OR CIR BKR	MOCP
50EZ-024---311	208/230-1-60	187	253	12.8	58.3	0.5	4.1	-/-	-/-	20.6/20.6	30/30	-
								3.8/5	18.1/20.8	43.2/46.7	45/50	-
								7.5/10	36.1/41.7	65.8/72.7	-	70/80
								5.4/7.2	25.9/30	53.0/58.1	60/60	-
								-/-	-/-	25.0/25.0	40/40	-
50EZ-030---311	208/230-1-60	187	253	16.0	77.0	0.9	4.1	3.8/5	18.1/20.8	47.6/51.1	50/60	-
								7.5/10	36.1/41.7	70.2/77.1	-	80/80
								11.3/15	54.2/62.5	92.7/103.2	-	100/110
								5.4/7.2	25.9/30	57.4/62.5	-	60/70
								-/-	-/-	27.7/27.7	40/40	-
50EZ-036---311	208/230-1-60	187	253	16.7	79.0	0.9	6.0	3.8/5	18.1/20.8	50.3/53.8	60/60	-
								7.5/10	36.1/41.7	72.9/79.8	-	80/80
								11.3/15	54.2/62.5	95.4/105.9	-	100/110
								5.4/7.2	25.9/30	60.1/65.2	-	70/70
								-/-	-/-	32.2/32.2	50/50	-
50EZ-042---311	208/230-1-60	187	253	20.2	112.0	0.9	6.0	3.8/5	18.1/20.8	54.8/58.2	60/60	-
								7.5/10	36.1/41.7	77.3/84.3	-	80/90
								11.3/15	54.2/62.5	99.9/110.3	-	100/125
								15/20	72.2/83.3	122.5/136.4	-	125/150
								5.4/7.2	25.9/30	64.6/69.6	-	70/70
50EZ-048---311	208/230-1-60	187	253	21.8	117.0	1.5	7.6	-/-	-/-	36.3/36.3	50/50	-
								3.8/5	18.1/20.8	58.9/62.4	-	60/70
								7.5/10	36.1/41.7	81.5/88.4	-	90/90
								11.3/15	54.2/62.5	104.0/114.5	-	110/125
								15/20	72.2/83.3	126.6/140.5	-	150/150
50EZ-060---311	208/230-1-60	187	253	26.4	134.0	1.5	7.6	5.4/7.2	25.9/30	68.7/73.8	-	70/80
								-/-	-/-	42.1/42.1	60/60	-
								3.8/5	18.1/20.8	64.7/68.2	-	70/70
								7.5/10	36.1/41.7	87.2/94.2	-	90/100
								11.3/15	54.2/62.5	109.8/120.2	-	110/125
50EZ-030---511	208/230-3-60	187	253	10.0	71.0	0.9	4.1	15/20	72.2/83.3	132.4/146.3	-	150/150
								5.4/7.2	25.9/30	74.5/79.6	-	80/80
								-/-	-/-	17.5/17.5	25/25	-
								3.8/5	10.4/12	30.5/32.5	35/35	-
								7.5/10	20.8/24.1	43.5/45.9	45/50	-
50EZ-036---511	208/230-3-60	187	253	10.4	88.0	0.9	6.0	11.3/15	31.3/36.1	56.6/62.6	-	60/70
								-/-	-/-	20.0/20.0	30/30	-
								3.8/5	10.4/12	33.0/35.0	35/35	-
								7.5/10	20.8/24.1	46.0/50.0	50/60	-
								11.3/15	31.3/36.1	59.0/65.1	60/70	-
50EZ-042---511	208/230-3-60	187	253	13.5	88.0	0.9	6.0	-/-	-/-	23.7/23.7	35/35	-
								3.8/5	10.4/12	36.8/38.8	40/40	-
								7.5/10	20.8/24.1	49.8/53.8	50/60	-
								11.3/15	31.3/36.1	62.8/68.8	-	70/70
								15/20	41.5/47.9	75.6/83.6	-	80/90
50EZ-048---511	208/230-3-60	187	253	14.1	83.1	1.5	7.6	-/-	-/-	26.7/26.7	40/40	-
								3.8/5	10.4/12	39.7/41.7	40/45	-
								7.5/10	20.8/24.1	52.8/56.8	60/60	-
								11.3/15	31.3/36.1	65.8/71.8	-	70/80
								15/20	41.5/47.9	78.6/86.6	-	80/90
50EZ-060---511	208/230-3-60	187	253	16.0	110.0	1.5	7.6	-/-	-/-	29.1/29.1	40/40	-
								3.8/5	10.4/12	42.1/44.1	45/45	-
								7.5/10	20.8/24.1	55.1/59.1	60/60	-
								11.3/15	31.3/36.1	68.1/74.2	-	70/80
								15/20	41.5/47.9	80.9/88.9	-	90/90
50EZ-036---601	460-3-60	414	506	5.8	38.0	0.6	3.0	-/-	-/-	10.8	15	-
								3.8/5	6.0	18.3	20	-
								7.5/10	12.0	25.9	30	-
								11.3/15	18.0	33.4	35	-
								-/-	-/-	11.4	15	-
50EZ-042---601	460-3-60	414	506	6.3	44.0	0.6	3.0	3.8/5	6.0	19.0	20	-
								7.5/10	12.0	26.5	30	-
								11.3/15	18.0	34.0	35	-
								15/20	24.1	41.5	45	-
								-/-	-/-	12.5	15	-
50EZ-048---601	460-3-60	414	506	6.2	41.0	0.9	3.8	3.8/5	6.0	20.0	20	-
								7.5/10	12.0	27.5	30	-
								11.3/15	18.0	35.0	35	-
								15/20	24.1	42.5	45	-
								-/-	-/-	14.4	20	-
50EZ-060---601	460-3-60	414	506	7.8	52.0	0.9	3.8	3.8/5	6.0	21.9	25	-
								7.5/10	12.0	29.4	30	-
								11.3/15	18.0	37.0	40	-
								15/20	24.1	44.5	45	-
								-/-	-/-	14.4	20	-

See Legend and Notes on next page.

- LEGEND
- FLA -- Full Load Amps
 - LRA -- Locked Rotor Amps
 - MCA -- Minimum Circuit Amps
 - MOCP -- Maximum Overcurrent Protection
 - RLA -- Rated Load Amps



EXAMPLE: Supply voltage is 230-3-60.



AB = 228 v
 BC = 231 v
 AC = 227 v

$$\begin{aligned} \text{Average Voltage} &= \frac{228 + 231 + 227}{3} \\ &= \frac{686}{3} \\ &= 229 \end{aligned}$$

NOTES:

1. In compliance with NEC (National Electrical Code) requirements for multimotor and combination load equipment (refer to NEC Articles 430 and 440), the overcurrent protective device for the unit shall be Power Supply fuse. The CGA (Canadian Gas Association) units may be fuse or circuit breaker.
2. Minimum wire size is based on 60 C copper wire. If other than 60 C wire is used, or if length exceeds wire length in table, determine size from NEC.
3. Unbalanced 3-Phase Supply Voltage
Never operate a motor where a phase imbalance in supply voltage is greater than 2%. Use the following formula to determine the percentage of voltage imbalance

% Voltage imbalance

$$= 100 \times \frac{\text{max voltage deviation from average voltage}}{\text{average voltage}}$$

Determine maximum deviation from average voltage.

(AB) 229 - 228 = 1 v
 (BC) 231 - 229 = 2 v
 (AC) 229 - 227 = 2 v

Maximum deviation is 2 v.

Determine percent of voltage imbalance



$$\begin{aligned} \% \text{ Voltage Imbalance} &= 100 \times \frac{2}{229} \\ &= 0.8\% \end{aligned}$$

This amount of phase imbalance is satisfactory as it is below the maximum allowable 2%.

IMPORTANT: If the supply voltage phase imbalance is more than 2%, contact your local electric utility company immediately.

50EZ

A06564

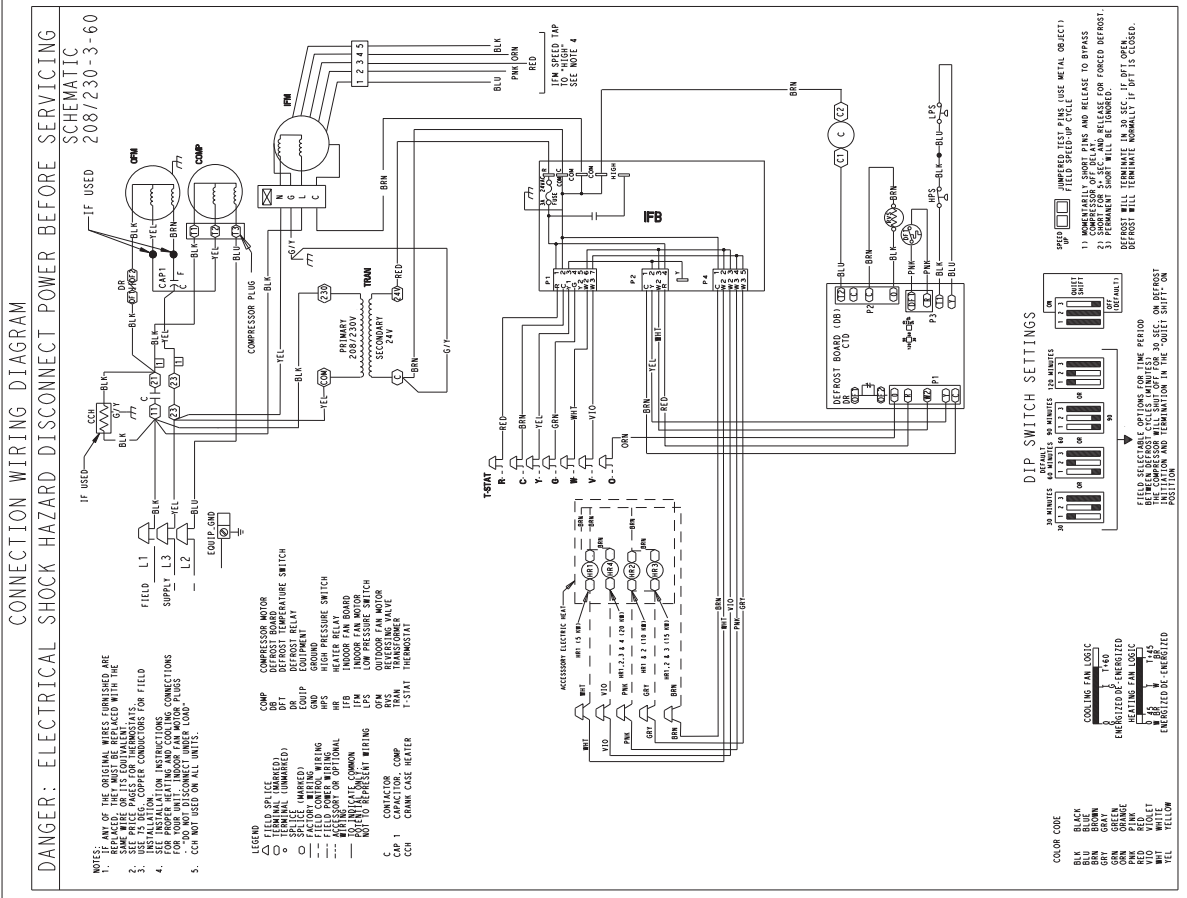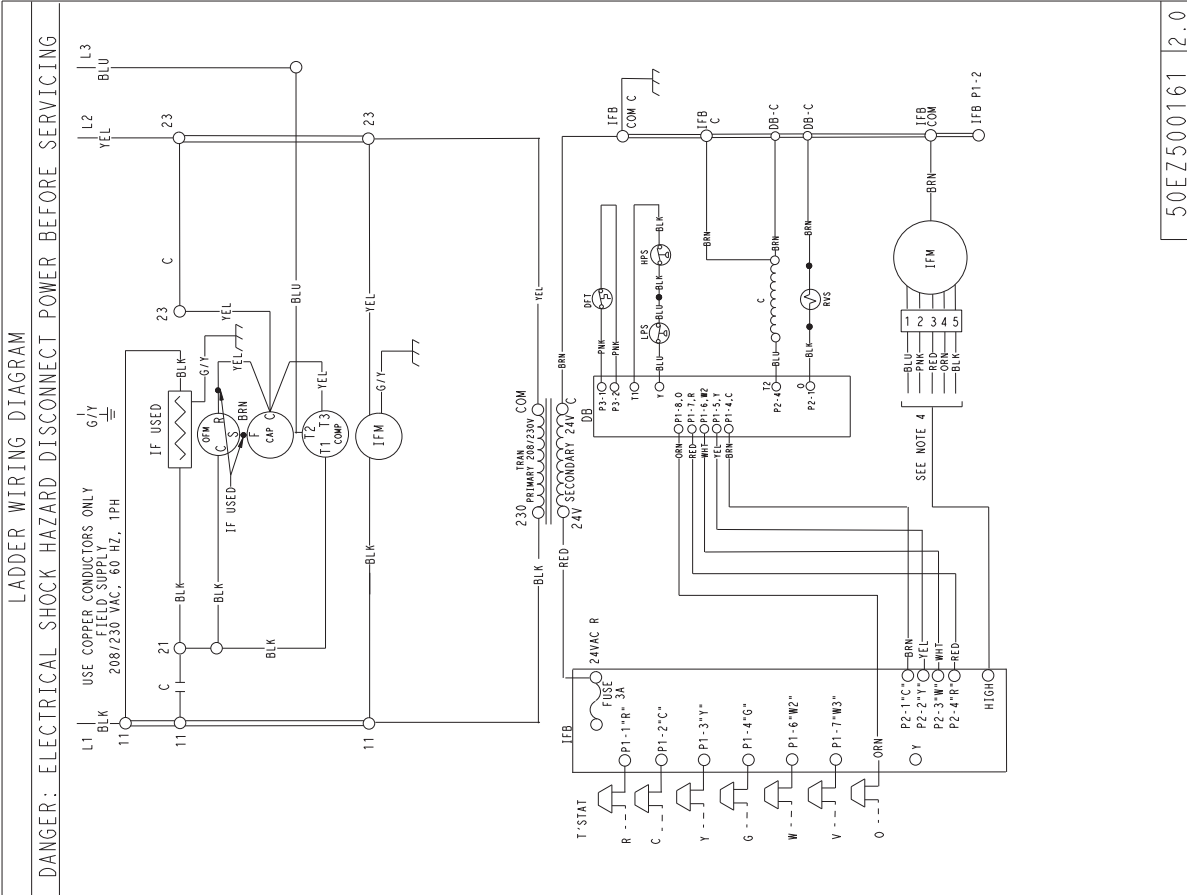

- NOTES:**
1. ANY OF THE ORIGINAL WIRES DISCONNECTED ARE REPEATED. THEY MUST BE REPEARED WITH THE SAME WIRE TYPE AND SIZE.
 2. SEE PRICE PAGES FOR DIMENSIONS.
 3. SEE PRICE PAGES FOR DIMENSIONS.
 4. SEE INSTALLATION INSTRUCTIONS FOR FIELD CONNECTIONS.
 5. CCH NOT USED ON ALL UNITS.

- LEGEND:**
- COMP COMPRESSOR MOTOR
 - DB DEFROST BOARD
 - DR DEFROST RELAY
 - EQ EQUIPMENT
 - HPS HIGH PRESSURE SWITCH
 - HR HEATER RELAY
 - IFM INDOOR FAN MOTOR
 - LPS LOW PRESSURE SWITCH
 - PM PRESSURE MOTOR
 - TRN TRANSFORMER
 - T-STAT THERMOSTAT
 - C CAP 1 CAPACITOR
 - CCH COMMON CASE HEATER

- DEFROST BOARD (DB) CTB**
- 1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31 32 33 34 35 36 37 38 39 40 41 42 43 44 45 46 47 48 49 50 51 52 53 54 55 56 57 58 59 60 61 62 63 64 65 66 67 68 69 70 71 72 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100

- DEFROST BOARD (DB) CTB**
- 1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31 32 33 34 35 36 37 38 39 40 41 42 43 44 45 46 47 48 49 50 51 52 53 54 55 56 57 58 59 60 61 62 63 64 65 66 67 68 69 70 71 72 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100

- DEFROST BOARD (DB) CTB**
- 1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31 32 33 34 35 36 37 38 39 40 41 42 43 44 45 46 47 48 49 50 51 52 53 54 55 56 57 58 59 60 61 62 63 64 65 66 67 68 69 70 71 72 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100


- DEFROST BOARD (DB) CTB**
- 1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31 32 33 34 35 36 37 38 39 40 41 42 43 44 45 46 47 48 49 50 51 52 53 54 55 56 57 58 59 60 61 62 63 64 65 66 67 68 69 70 71 72 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100

- DEFROST BOARD (DB) CTB**
- 1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31 32 33 34 35 36 37 38 39 40 41 42 43 44 45 46 47 48 49 50 51 52 53 54 55 56 57 58 59 60 61 62 63 64 65 66 67 68 69 70 71 72 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100

- DEFROST BOARD (DB) CTB**
- 1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31 32 33 34 35 36 37 38 39 40 41 42 43 44 45 46 47 48 49 50 51 52 53 54 55 56 57 58 59 60 61 62 63 64 65 66 67 68 69 70 71 72 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100


CONNECTION WIRING DIAGRAM

DANGER: ELECTRICAL SHOCK HAZARD DISCONNECT POWER BEFORE SERVICING

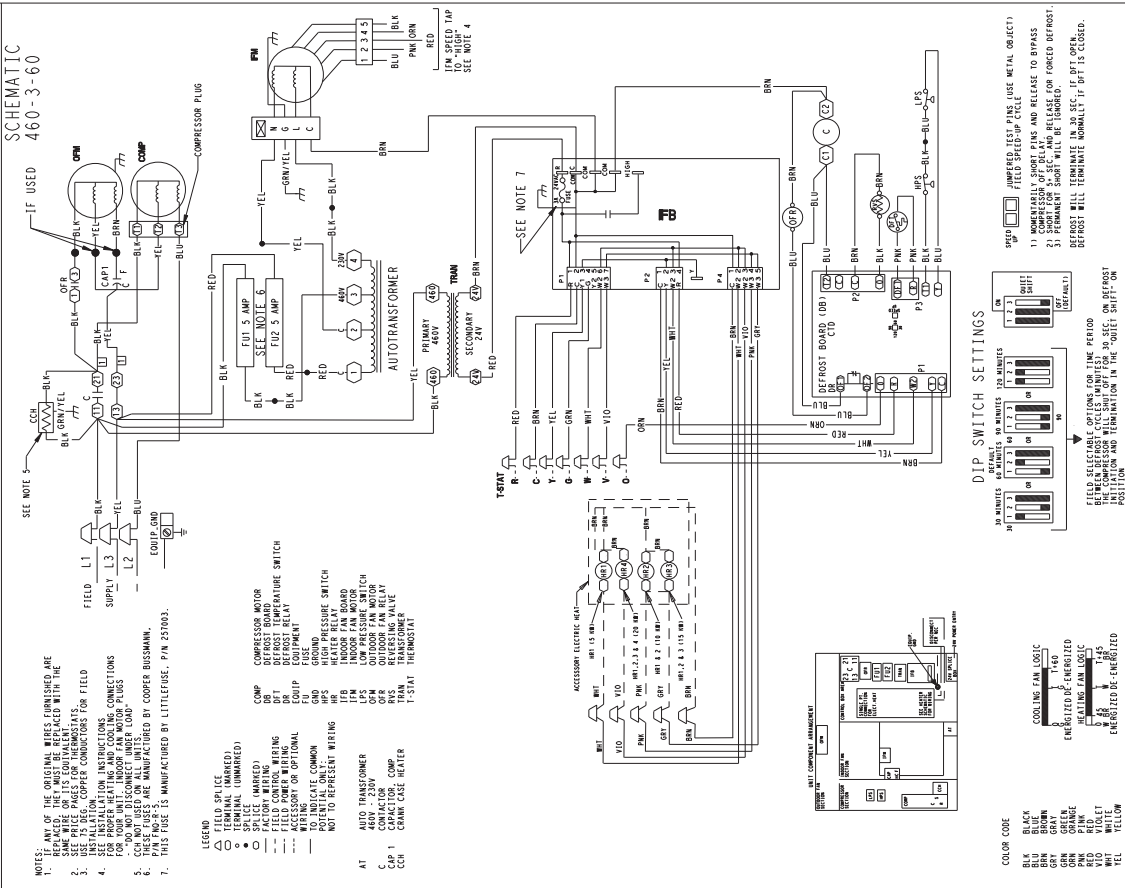

LADDER WIRING DIAGRAM

DANGER: ELECTRICAL SHOCK HAZARD DISCONNECT POWER BEFORE SERVICING

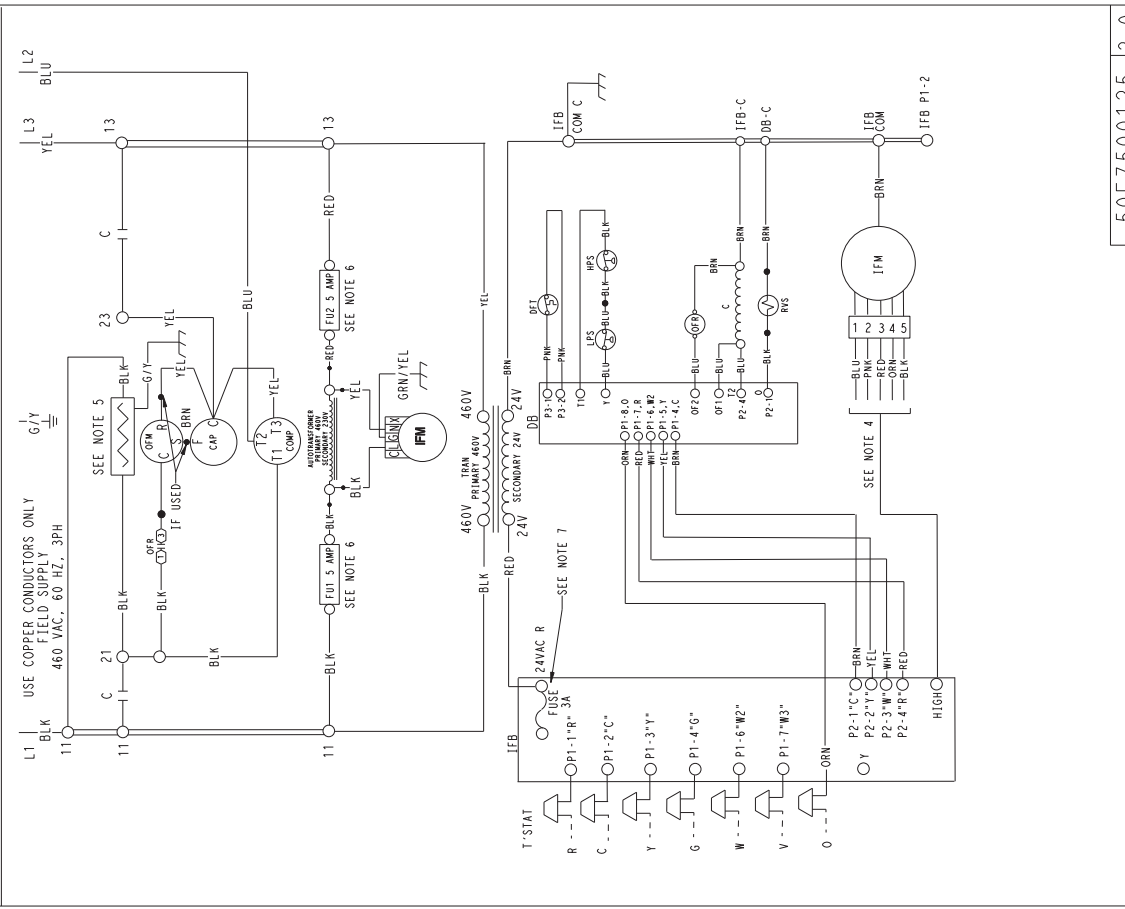

CONTROLS

Operating sequence

When power is supplied to unit, the transformer (TRAN) is energized.

On units with crankcase heater, heater is also energized.

Cooling — With the thermostat in the cooling position, the thermostat makes circuit R-O. This energizes the reversing valve solenoid (RVS) and places the unit in standby condition for cooling.

As the space temperature rises, the thermostat closes circuit R-Y. A circuit is made to contactor (C), starting the compressor (COMP) and outdoor-fan motor (OFM). Circuit R-G is made at the same time and starts the indoor-fan motor (IFM).

When the thermostat is satisfied, contacts open, deenergizing C. The COMP and OFM stop, and the IFM stops after the preselected time delay.

Heating — On a call for heat, thermostat makes circuits R-Y and R-G.

A circuit is made to C, starting COMP and OFM. Circuit R-G also is completed, energizing IFR and starting IFM after the selected time delay.

Should room temperature continue to fall, circuit R-W is made through second-stage thermostat. If optional electric heat package is used, a relay is energized, bringing on first bank of supplemental electric heat. When thermostat is satisfied, contacts open, deenergizing contactor and relay; motors and heaters deenergize.

Defrost — Defrost board (DB) is a time and temperature control, which includes a field-selectable time period (dip switch 1 and 2 on the board) between checks for defrost (30, 60, 90, or 120 minutes). Electronic timer and defrost cycle start only when contactor is energized and defrost thermostat (DFT) is closed.

The defrost board is also equipped with a third dip switch for selecting Quiet Shift operation. The Quiet Shift operation turns compressor off at defrost initiation and termination. Unit is factory shipped with quiet shift turned off.

Defrost mode is identical to cooling mode, except outdoor fan motor stops and a bank of optional electric heat turns on to warm air supplying the conditioned space.

NOTE:

1. Compressor time delay occurs through the defrost control board.
2. Defrost control board has built in 5 minute compressor delay; once the compressor has started and then stopped, it cannot be restarted again until 5 minutes have elapsed.

GUIDE SPECIFICATIONS (CONT)

Packaged Heat Pumps

HVAC Guide Specifications

Size Range: **2 to 5 Tons, Nominal Cooling**

Carrier Model Number: **50EZ**

Part 1—General

SYSTEM DESCRIPTION

Outdoor, packaged, air-to-air heat pump unit utilizing a hermetic scroll compressor for cooling duty and optional electric heating. Unit shall discharge supply air vertically or horizontally as shown on contract drawings. Outdoor fan/coil section shall have a draw-thru design with vertical discharge for minimum sound levels.

QUALITY ASSURANCE

- A. Unit shall be rated in accordance with ARI Standards 210/240 and 270.
- B. Unit shall be designed in accordance with UL Standard 1995.
- C. Unit shall be manufactured in a facility registered to ISO 9001 manufacturing quality standard.
- D. Unit shall be UL listed and c-UL certified as a total package for safety requirements.
- E. Roof curb shall be designed to conform to NRCA Standards.
- F. Insulation and adhesives shall meet NFPA 90A requirements for flame spread and smoke generation.
- G. Cabinet insulation shall meet ASHRAE Standard 62P.

DELIVERY, STORAGE AND HANDLING

Unit shall be stored and handled per manufacturer's recommendations.

Part 2 — Products

EQUIPMENT

A. General:

Factory-assembled, single-piece, heat pump unit. Contained within the enclosure shall be all factory wiring, piping, controls, refrigerant charge (R-22), and special features required prior to field start-up.

B. Unit Cabinet:

- 1. Unit cabinet shall be constructed of phosphated, zinc-coated, pre-painted steel capable of withstanding 500 hours of salt spray.
- 2. Normal service shall be through a single removable cabinet panel.
- 3. The unit shall be constructed on a rust proof unit base that has an externally trapped, integrated sloped drain.
- 4. Indoor fan compartment top surface shall be insulated with a minimum 1/2-in. (12.7 mm) thick, flexible fiberglass insulation, coated on the air side and retained by adhesive and mechanical means. The indoor wall sections will be insulated with a minimum semi-rigid, foil-faced board capable of being wiped clean. Aluminum foil-faced fiberglass insulation shall be used in the entire indoor air cavity section.
- 5. Unit shall have a field-supplied condensate trap.
- 6. Metal Insulated Duct Covers for side discharge will be standard on all sizes.
- 7. Unit insulation conforms to ASHRAE 62P.

C. Fans:

- 1. The indoor fan shall be 5-speed, direct-drive, as shown on equipment drawings.

- 2. Fan wheel shall be made from steel and shall be double-inlet type with forward-curved blades with corrosion resistant finish. Fan wheel shall be dynamically balanced.
- 3. Outdoor fan shall be direct-drive, propeller-type with aluminum blades riveted to corrosion resistant steel spiders, be dynamically balanced, and discharge air vertically.

D. Compressor:

- 1. Fully hermetic compressors with factory-installed vibration isolation.
- 2. Scroll compressors shall be standard on all units.
- 3. Compressor Protection:
Defrost control shall protect compressor by preventing "short cycling."

E. Coils:

Indoor and outdoor coils shall have aluminum plate fins mechanically bonded to seamless copper tubes with all joints brazed. (Copper/copper and vinyl-coated construction available as option.) Tube sheet openings shall be belled to prevent tube wear.

F. Refrigerant Metering Device:

Refrigerant metering device shall be thermostatic expansion valve for cooling, and fixed orifice for heating.

G. Filters:

Filter section shall consist of field-installed, throwaway, 1-in.-thick fiberglass filters of commercially available sizes.

H. Controls and Safeties:

- 1. Unit controls shall be complete with a self-contained, low-voltage control circuit.
- 2. Units shall incorporate an internal compressor protector that provides reset capability.

I. Operating Characteristics:

- 1. Unit shall be capable of starting and running at 125°F (51.7°C) ambient outdoor temperature.
- 2. Compressor with standard controls shall be capable of operation down to 40°F (4.4°C) ambient outdoor temperature in cooling mode.
- 3. Unit shall be provided with 60-second fan time delay after the thermostat is satisfied.

J. Electrical Requirements:

All unit power wiring shall enter the unit cabinet at a single location.

K. Motors:

- 1. Compressor motors shall be of the refrigerant-cooled type with line-break thermal and current overload protection.
- 2. All fan motors shall have permanently lubricated bearings, and inherent, automatic reset, thermal overload protection.
- 3. Condenser fan motor shall be totally enclosed.

L. Special Features Available:

- 1. Louvered Grille:
Wire grille shall be standard on all units. Louvered grille shall be available as a factory-installed option to provide hail guard and vandalism protection.
- 2. Coil Options:
Shall include factory-installed optional copper/copper and vinyl-coated refrigerant coils.
- 3. Economizer:
 - a. Economizer controls capable of providing free cooling using outside air.
 - b. Equipped with low leakage dampers not to exceed 3% leakage, at 1.0 in. wc pressure differential.
 - c. Spring return motor shuts off outdoor damper on power failure.

GUIDE SPECIFICATIONS (CONT)

4. Flat Roof Curb:
Curbs shall have seal strip and a wood nailer for flashing and shall be installed per manufacturer's instructions.
5. Manual Outdoor Air Damper:
Package shall consist of damper, birdscreen, and rainhood which can be preset to admit outdoor air for year-round ventilation.
6. Thermostat:
To provide for two-stage heating and one-stage cooling in addition manual or automatic changeover and indoor fan control.
7. Low Ambient Package:
Shall consist of a solid-state control and outdoor coil temperature sensor for controlling outdoor-fan motor operation, which shall allow unit to operate down to 0°F (-17.7°C) outdoor ambient temperature.
8. Filter Rack Kit:
Shall provide filter mounting for downflow applications.
9. Square-To-Round Duct Transitions (024-048):
Shall have the ability to convert the supply and return openings from rectangular to round.
10. Crankcase Heater:
Shall provide anti-floodback protection for lowload cooling applications.
11. Electric heaters:
 - a. Electric heater shall be available as a field installed option.
 - b. Heater elements shall be open wire type, adequately supported and insulated with ceramic bushings.
 - c. Electric heater packages must provide single point power connection capability.

